


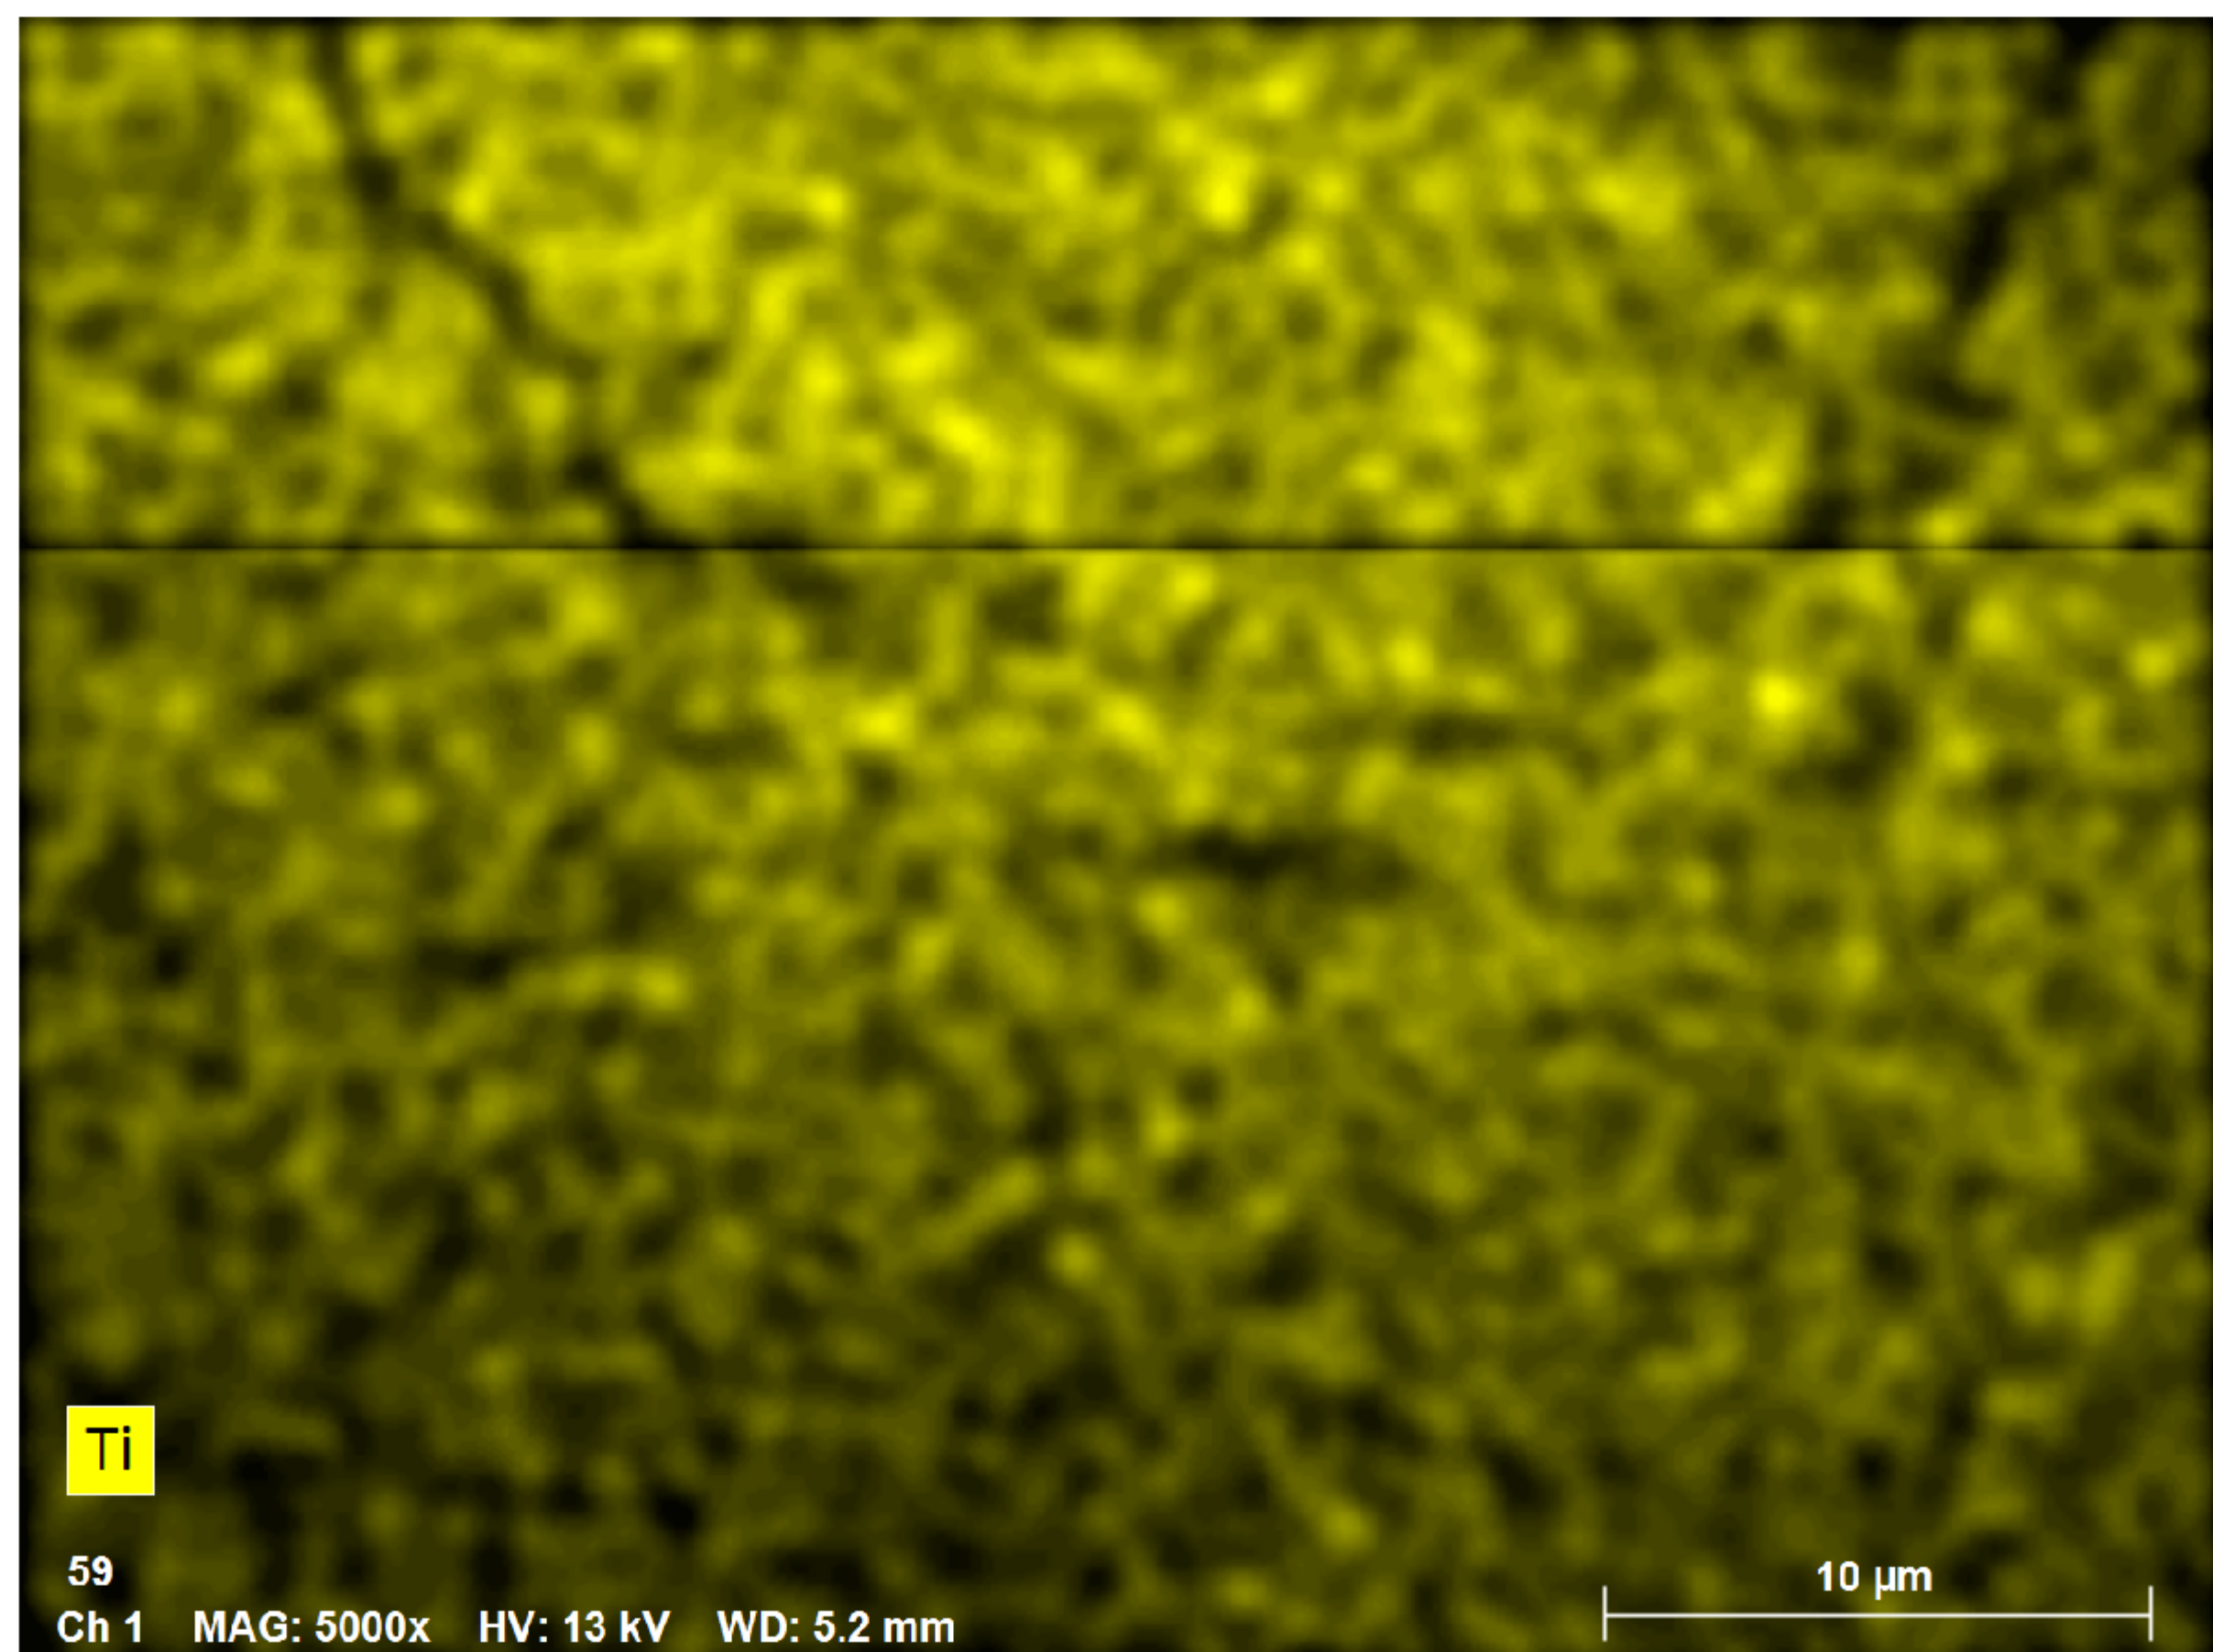


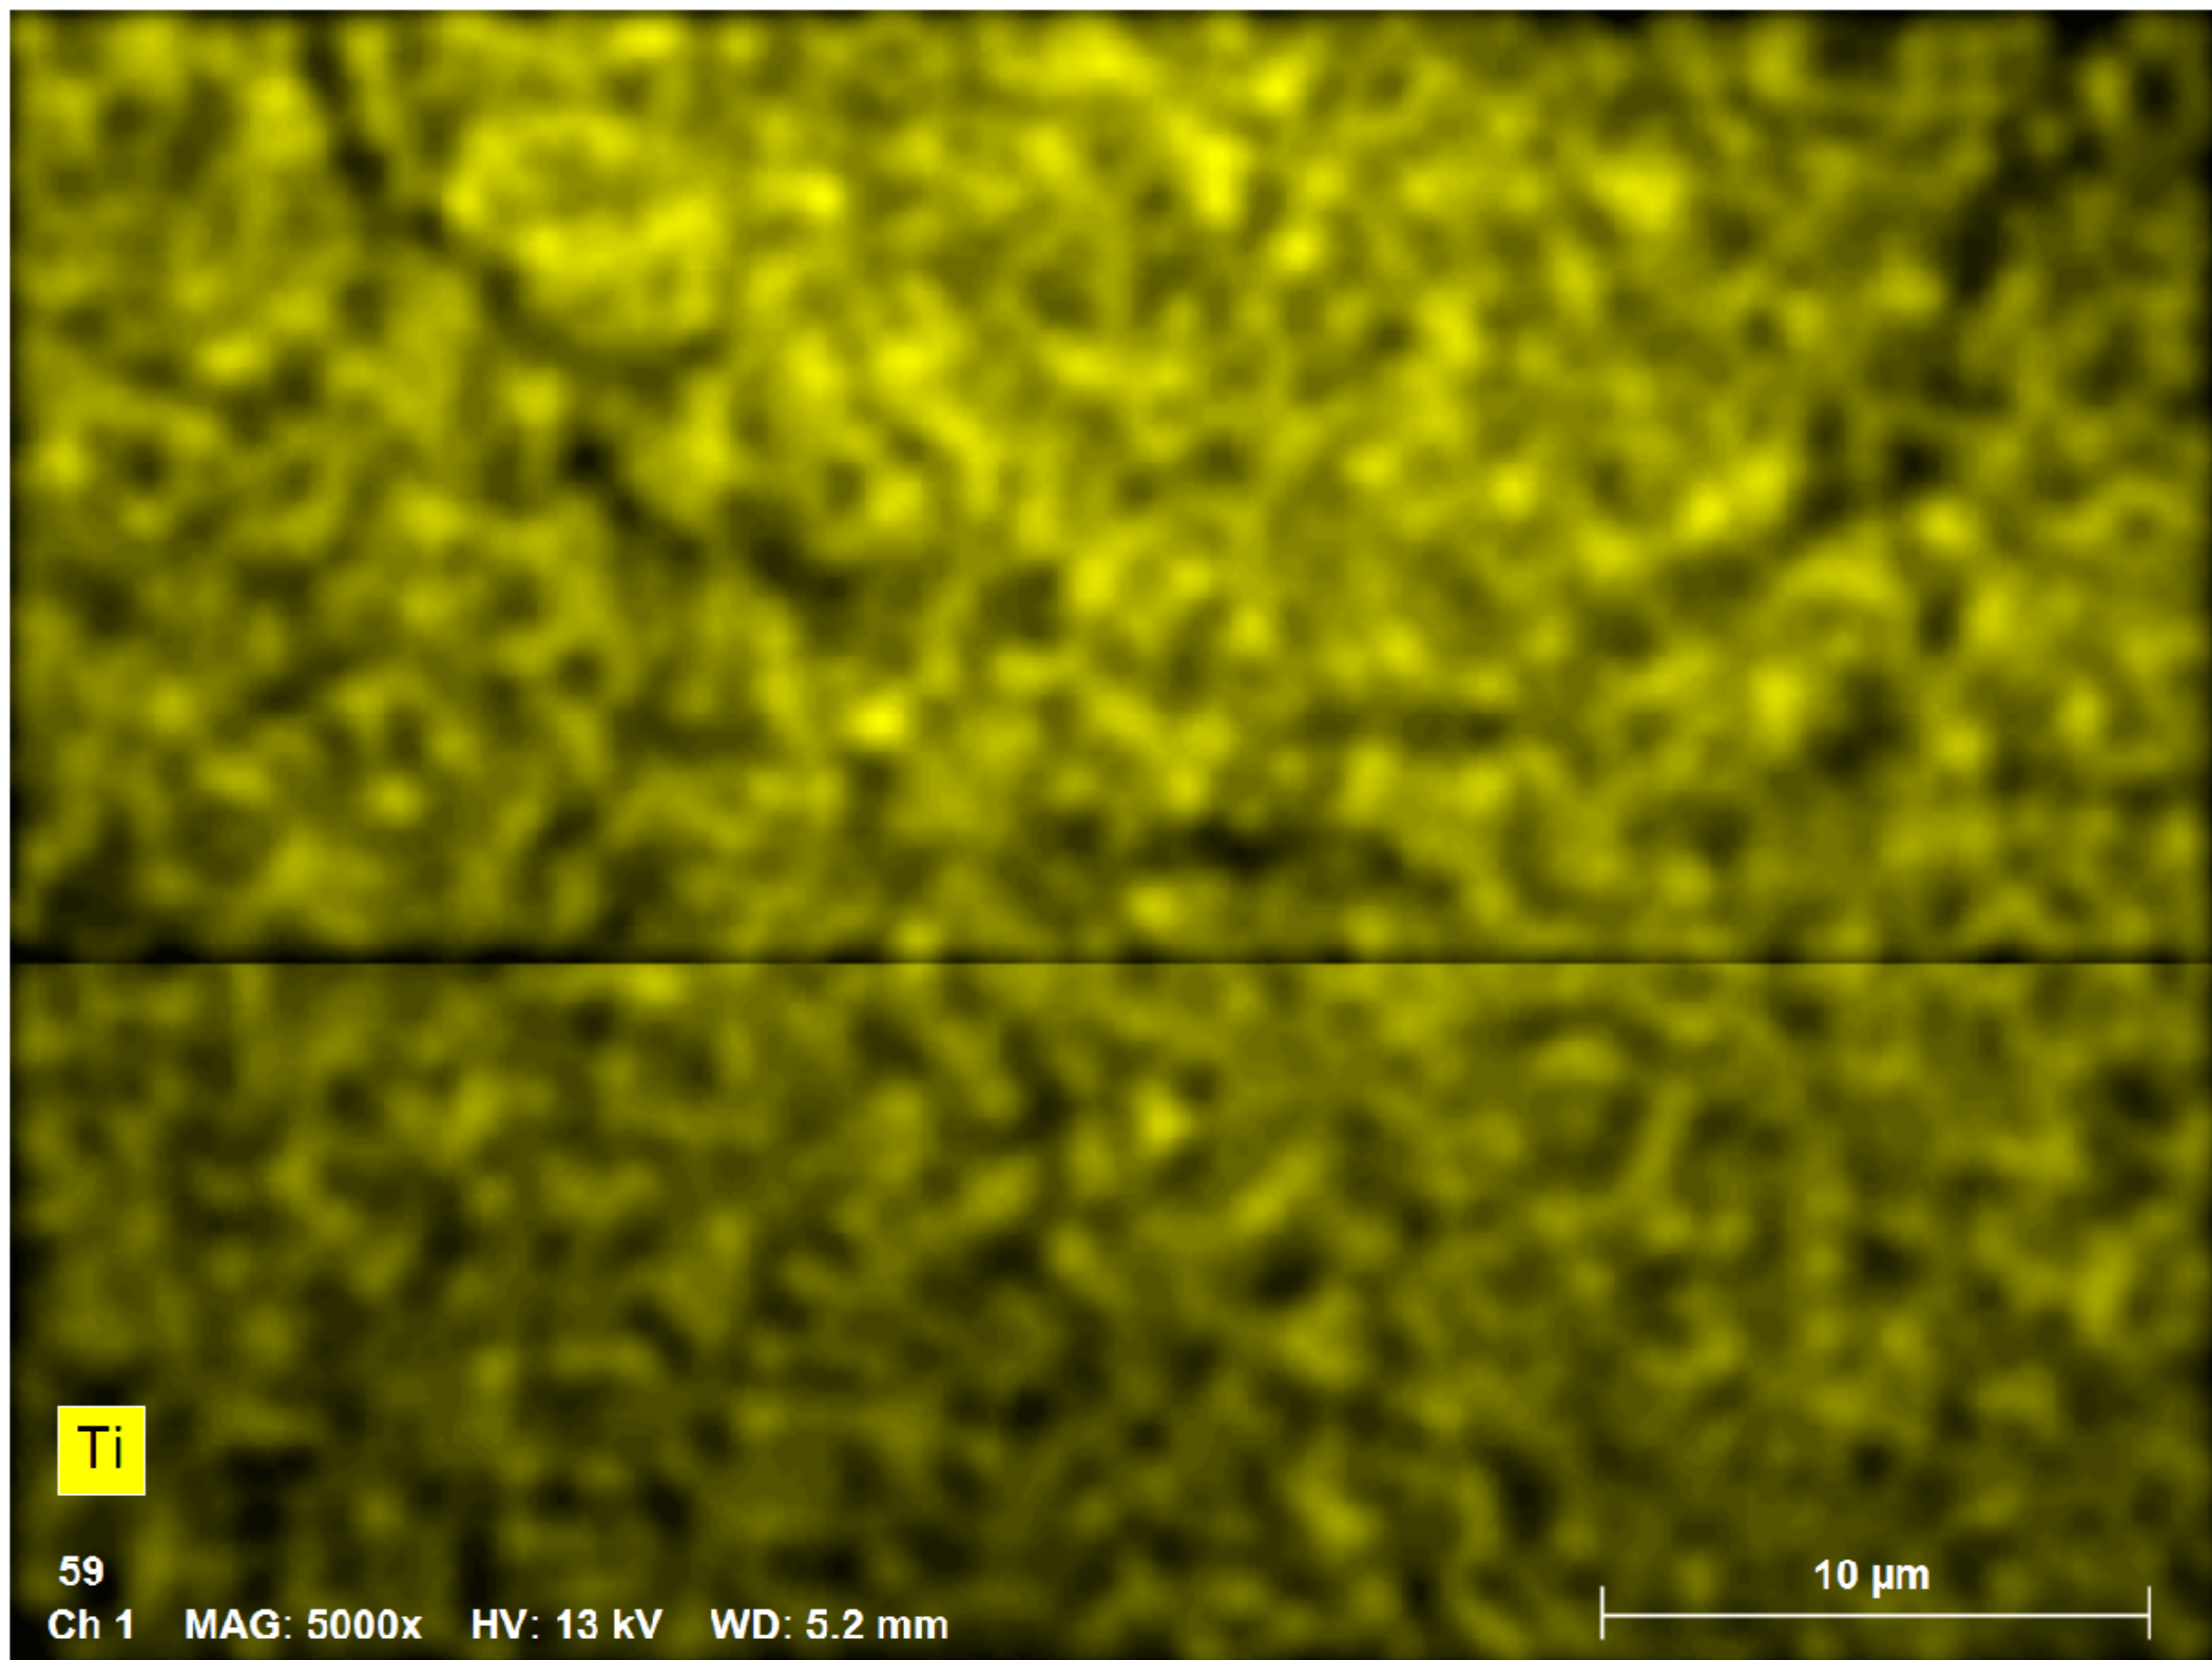








Application Note

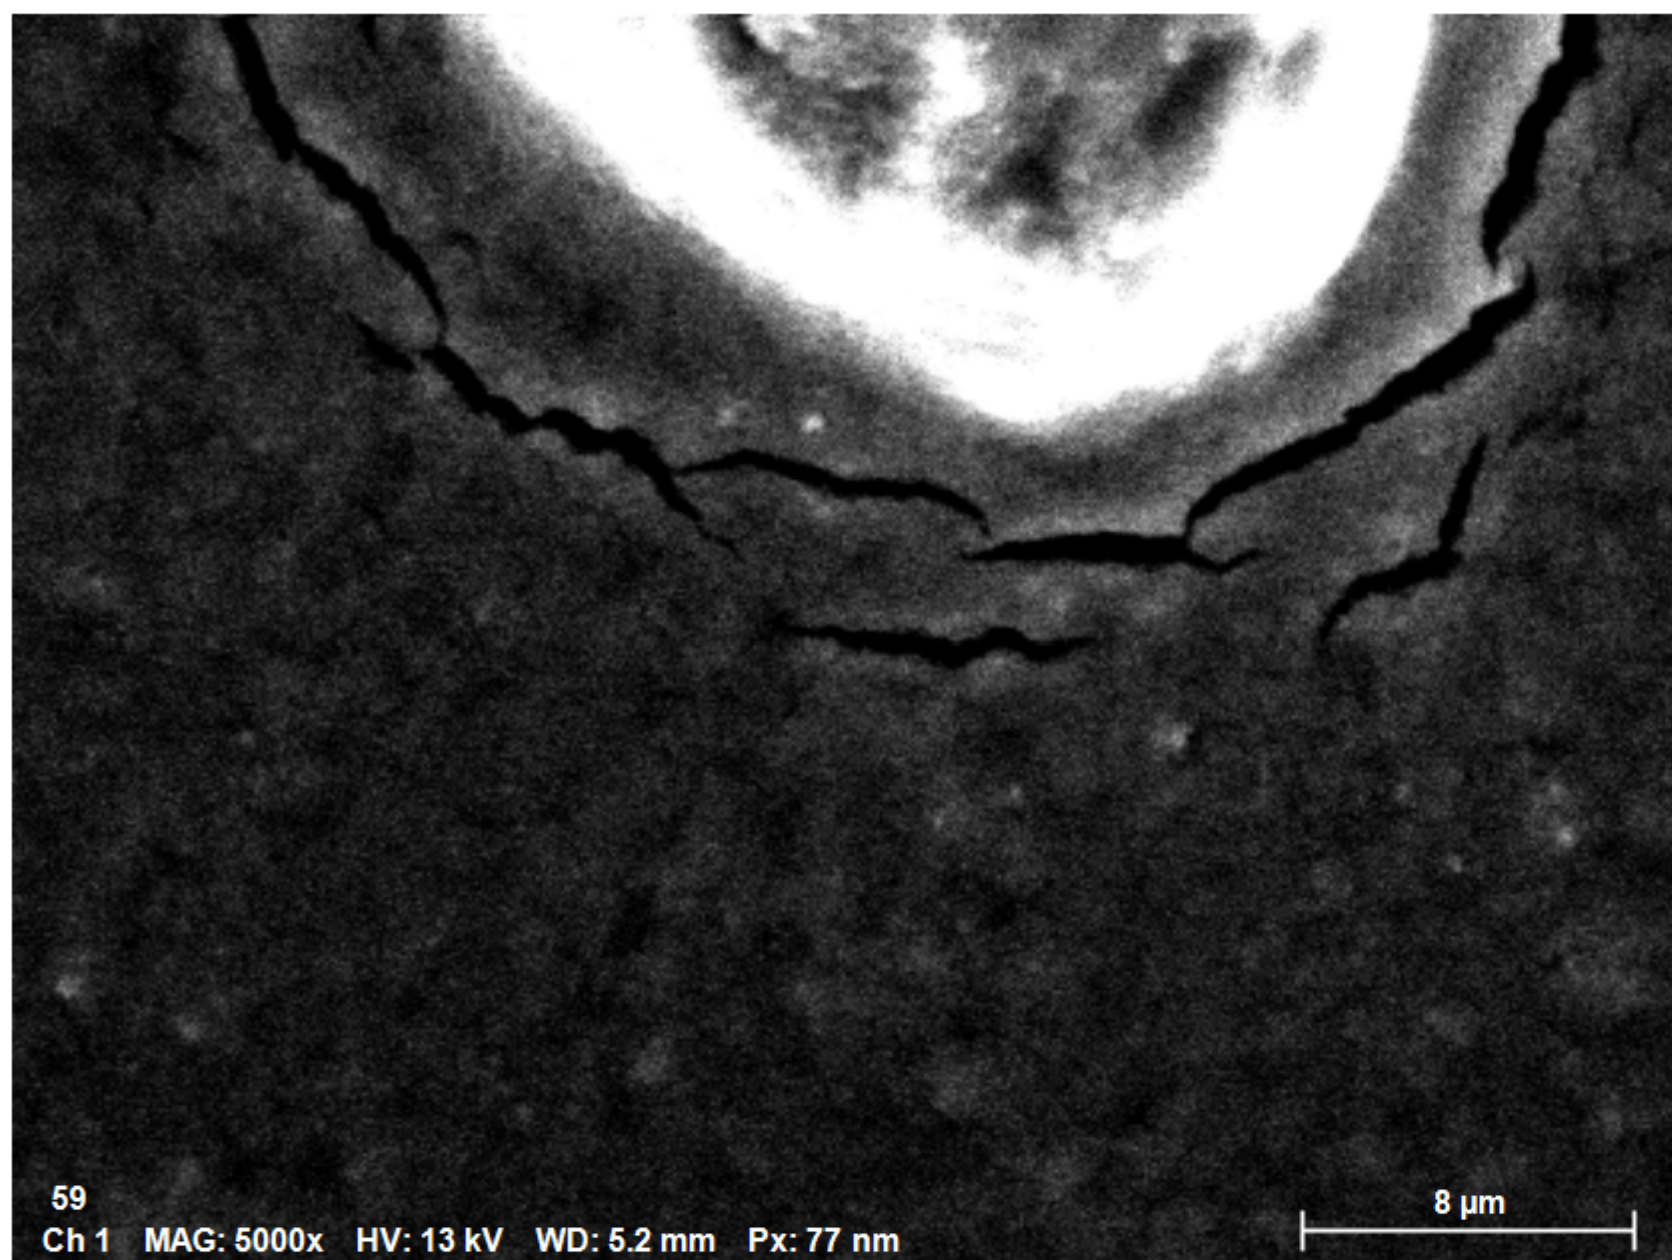

Name	Date	Time	HV [kV]	Mag	WD [mm]
59	3/27/2025	11:07:20 AM	13.0 keV	5000x	5.2 mm

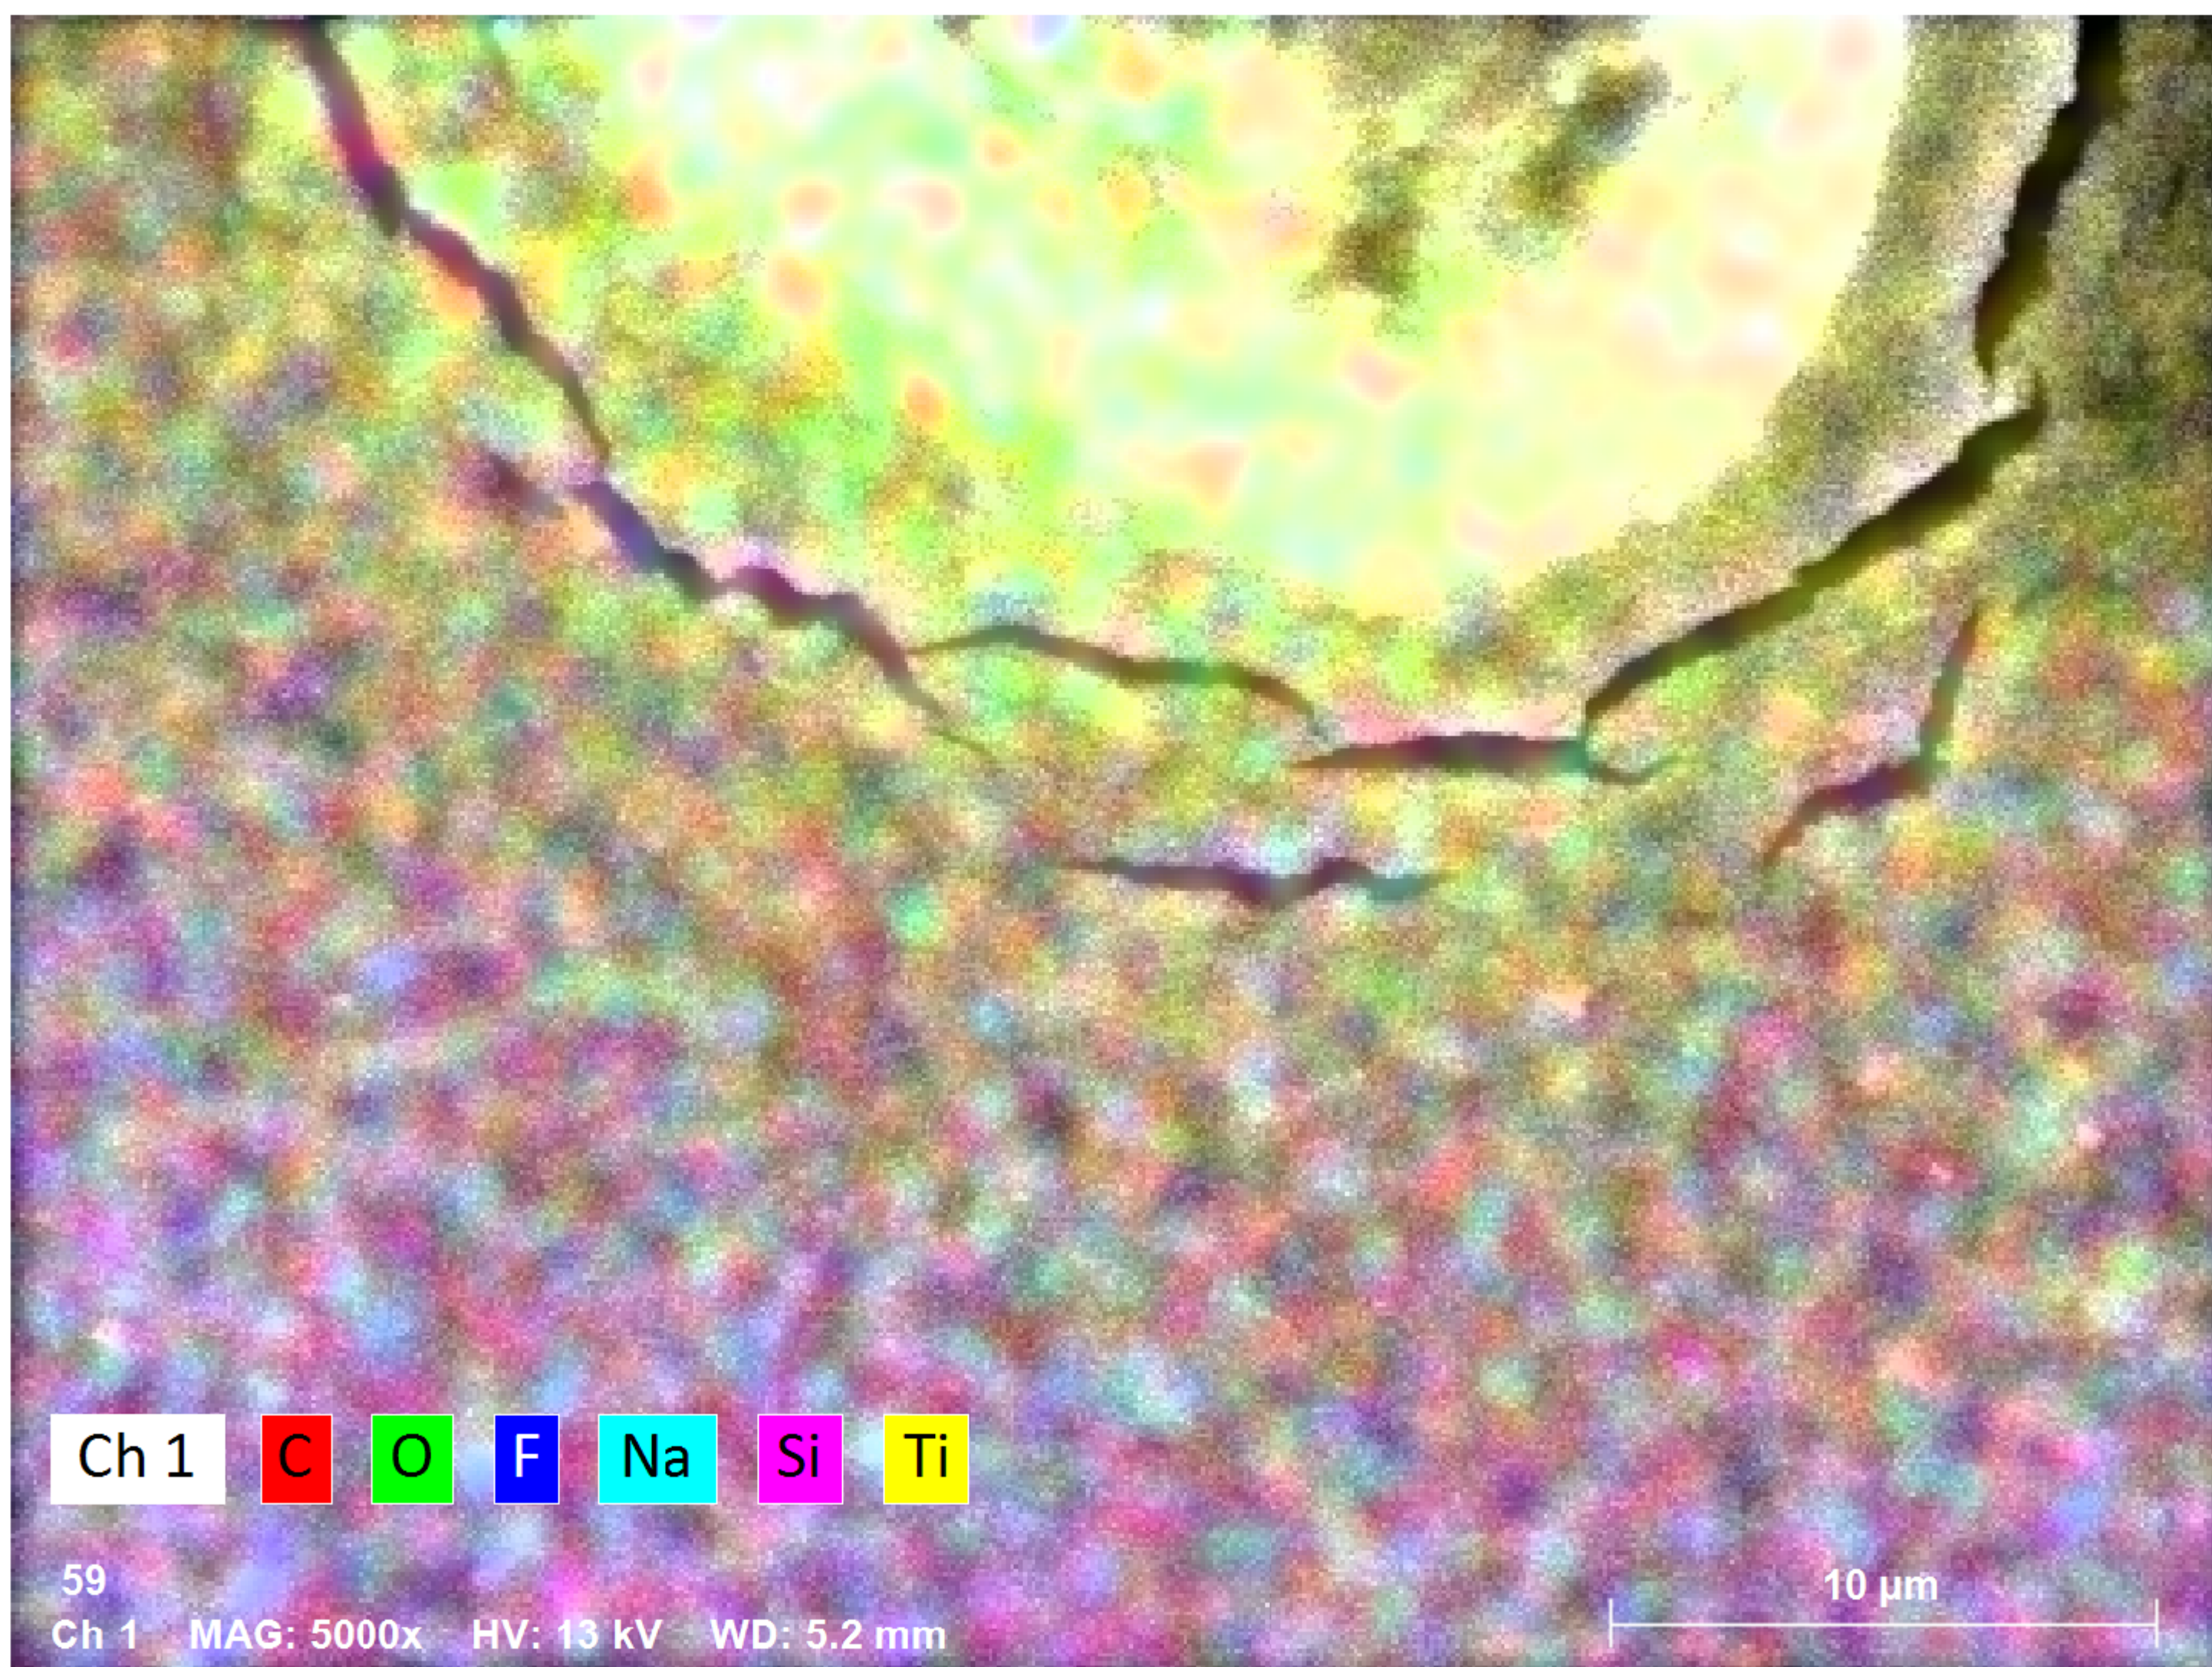


Name	Date	Time	HV [kV]	Mag	WD [mm]
59	3/27/2025	11:07:33 AM	13.0 keV	5000x	5.2 mm
	3/27/2025				

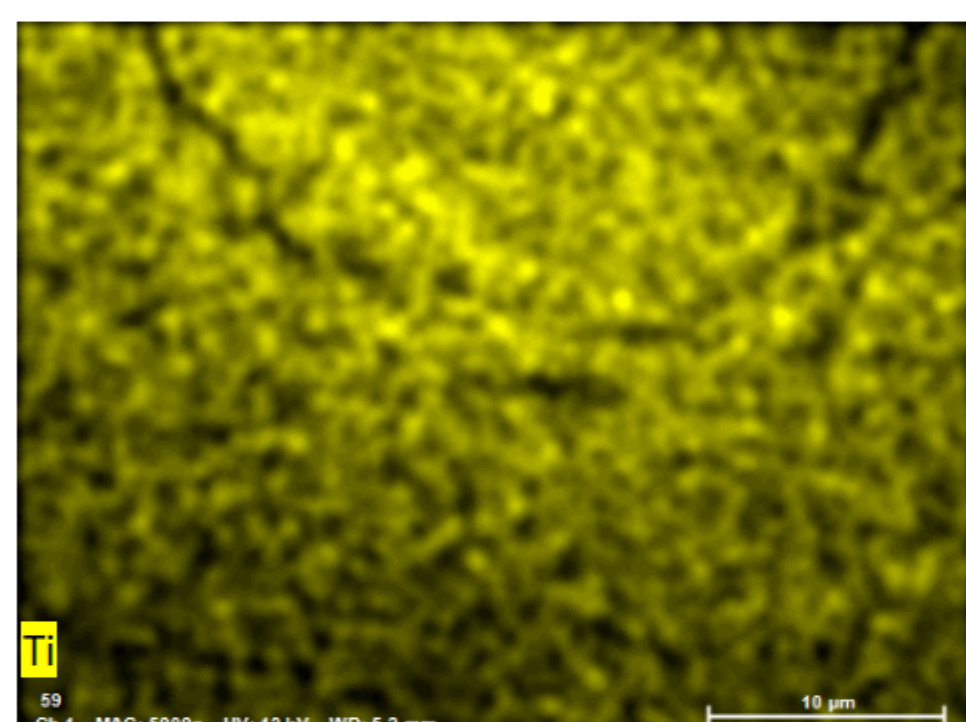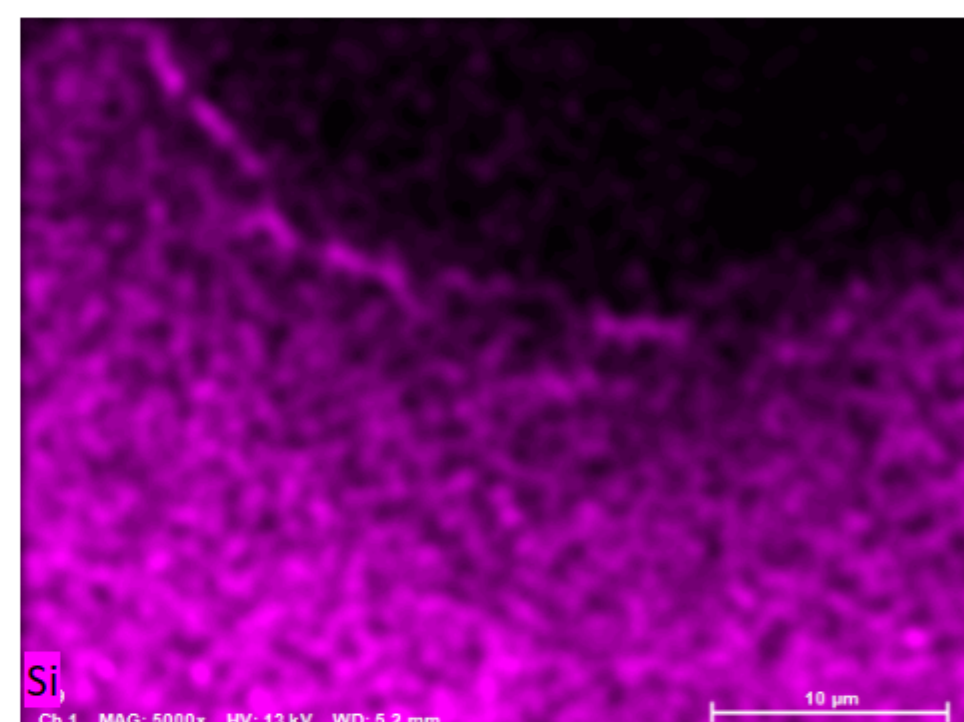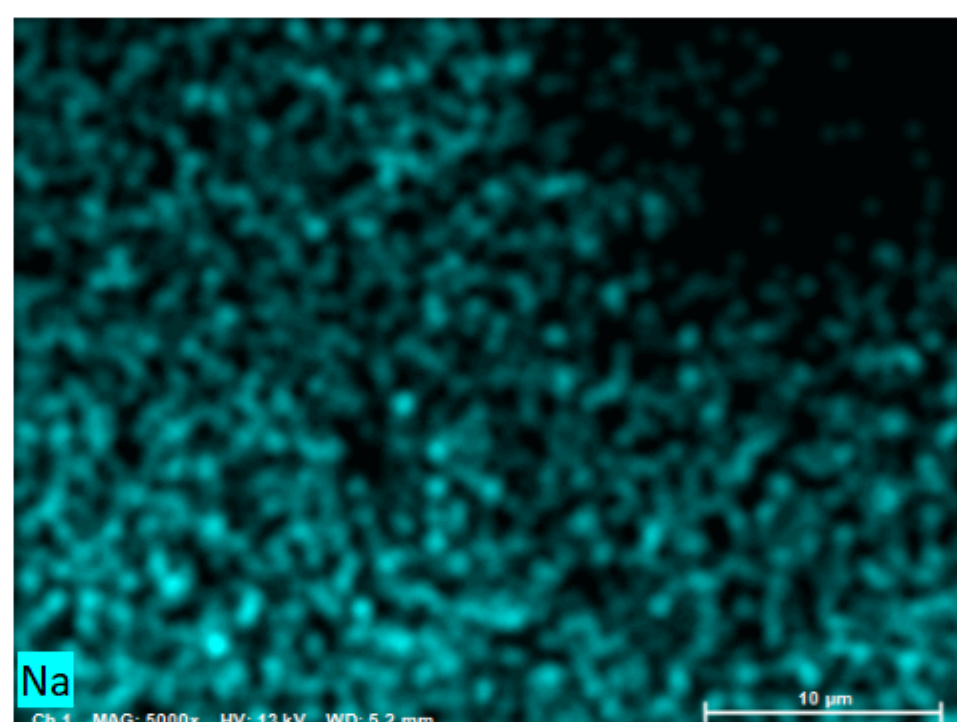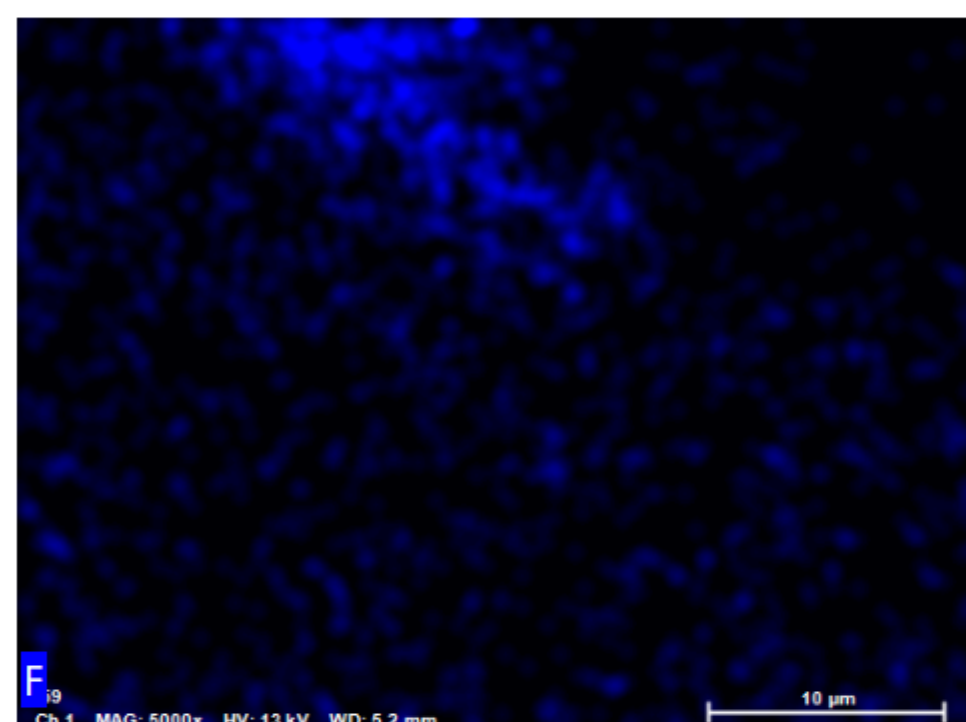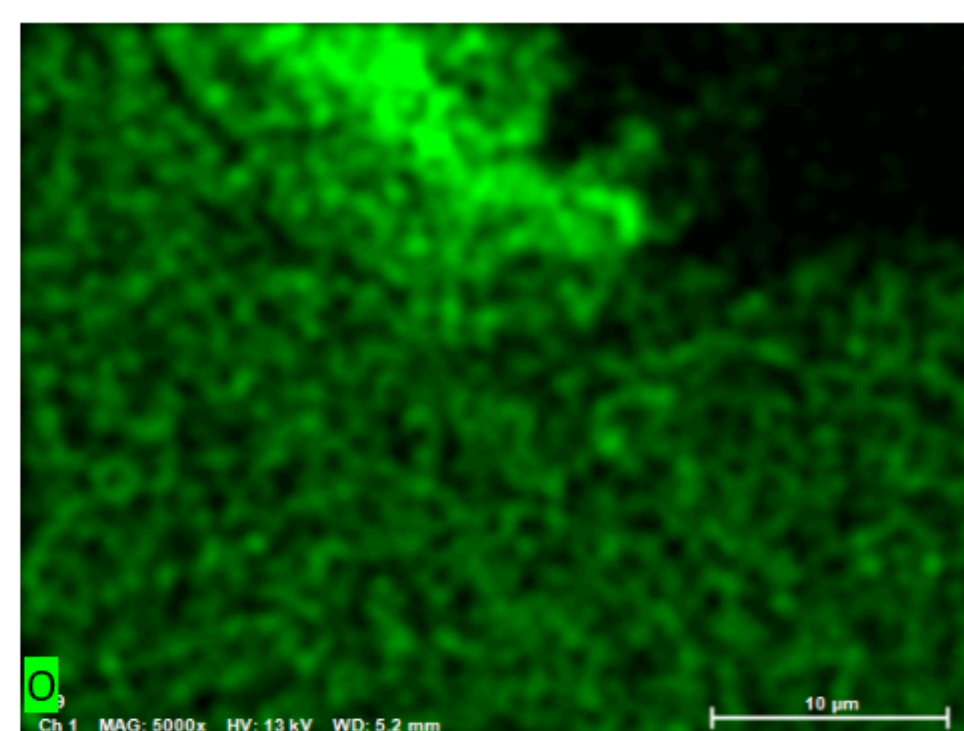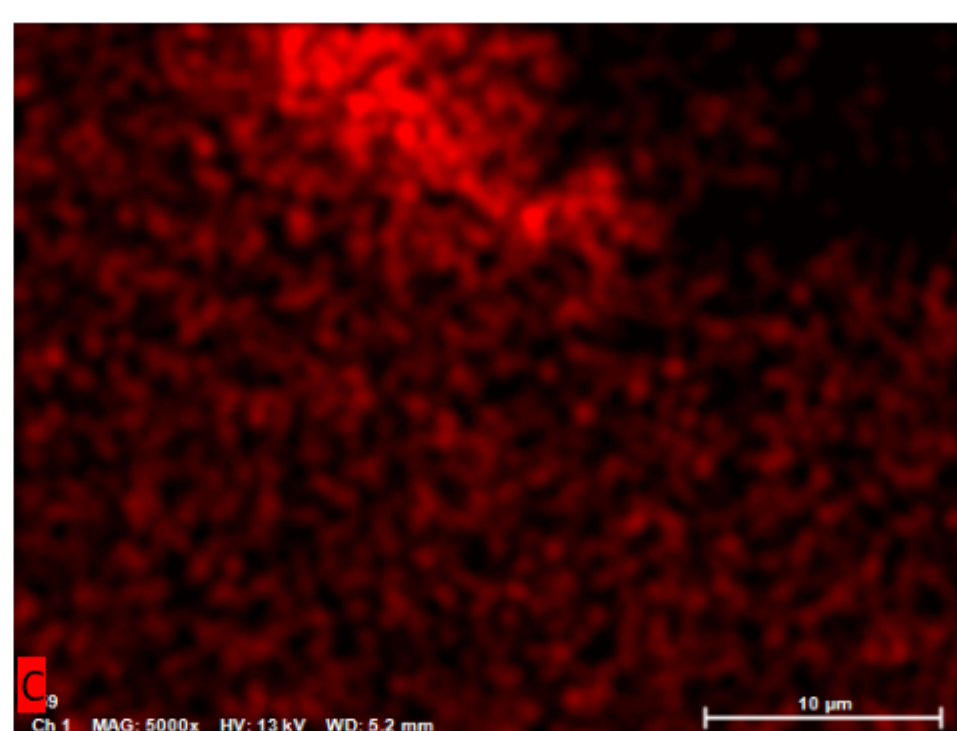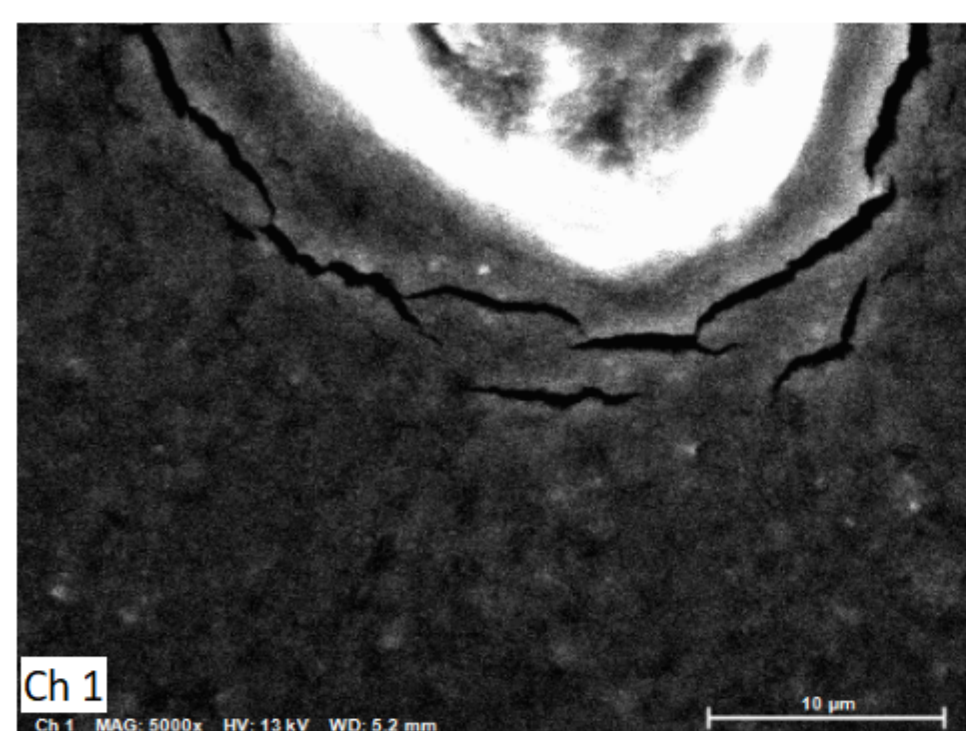

Date	Time	HV [kV]	Mag	WD [mm]
3/27/2025	11:07:33 AM	13.0 keV	5000x	5.2 mm


Application Note

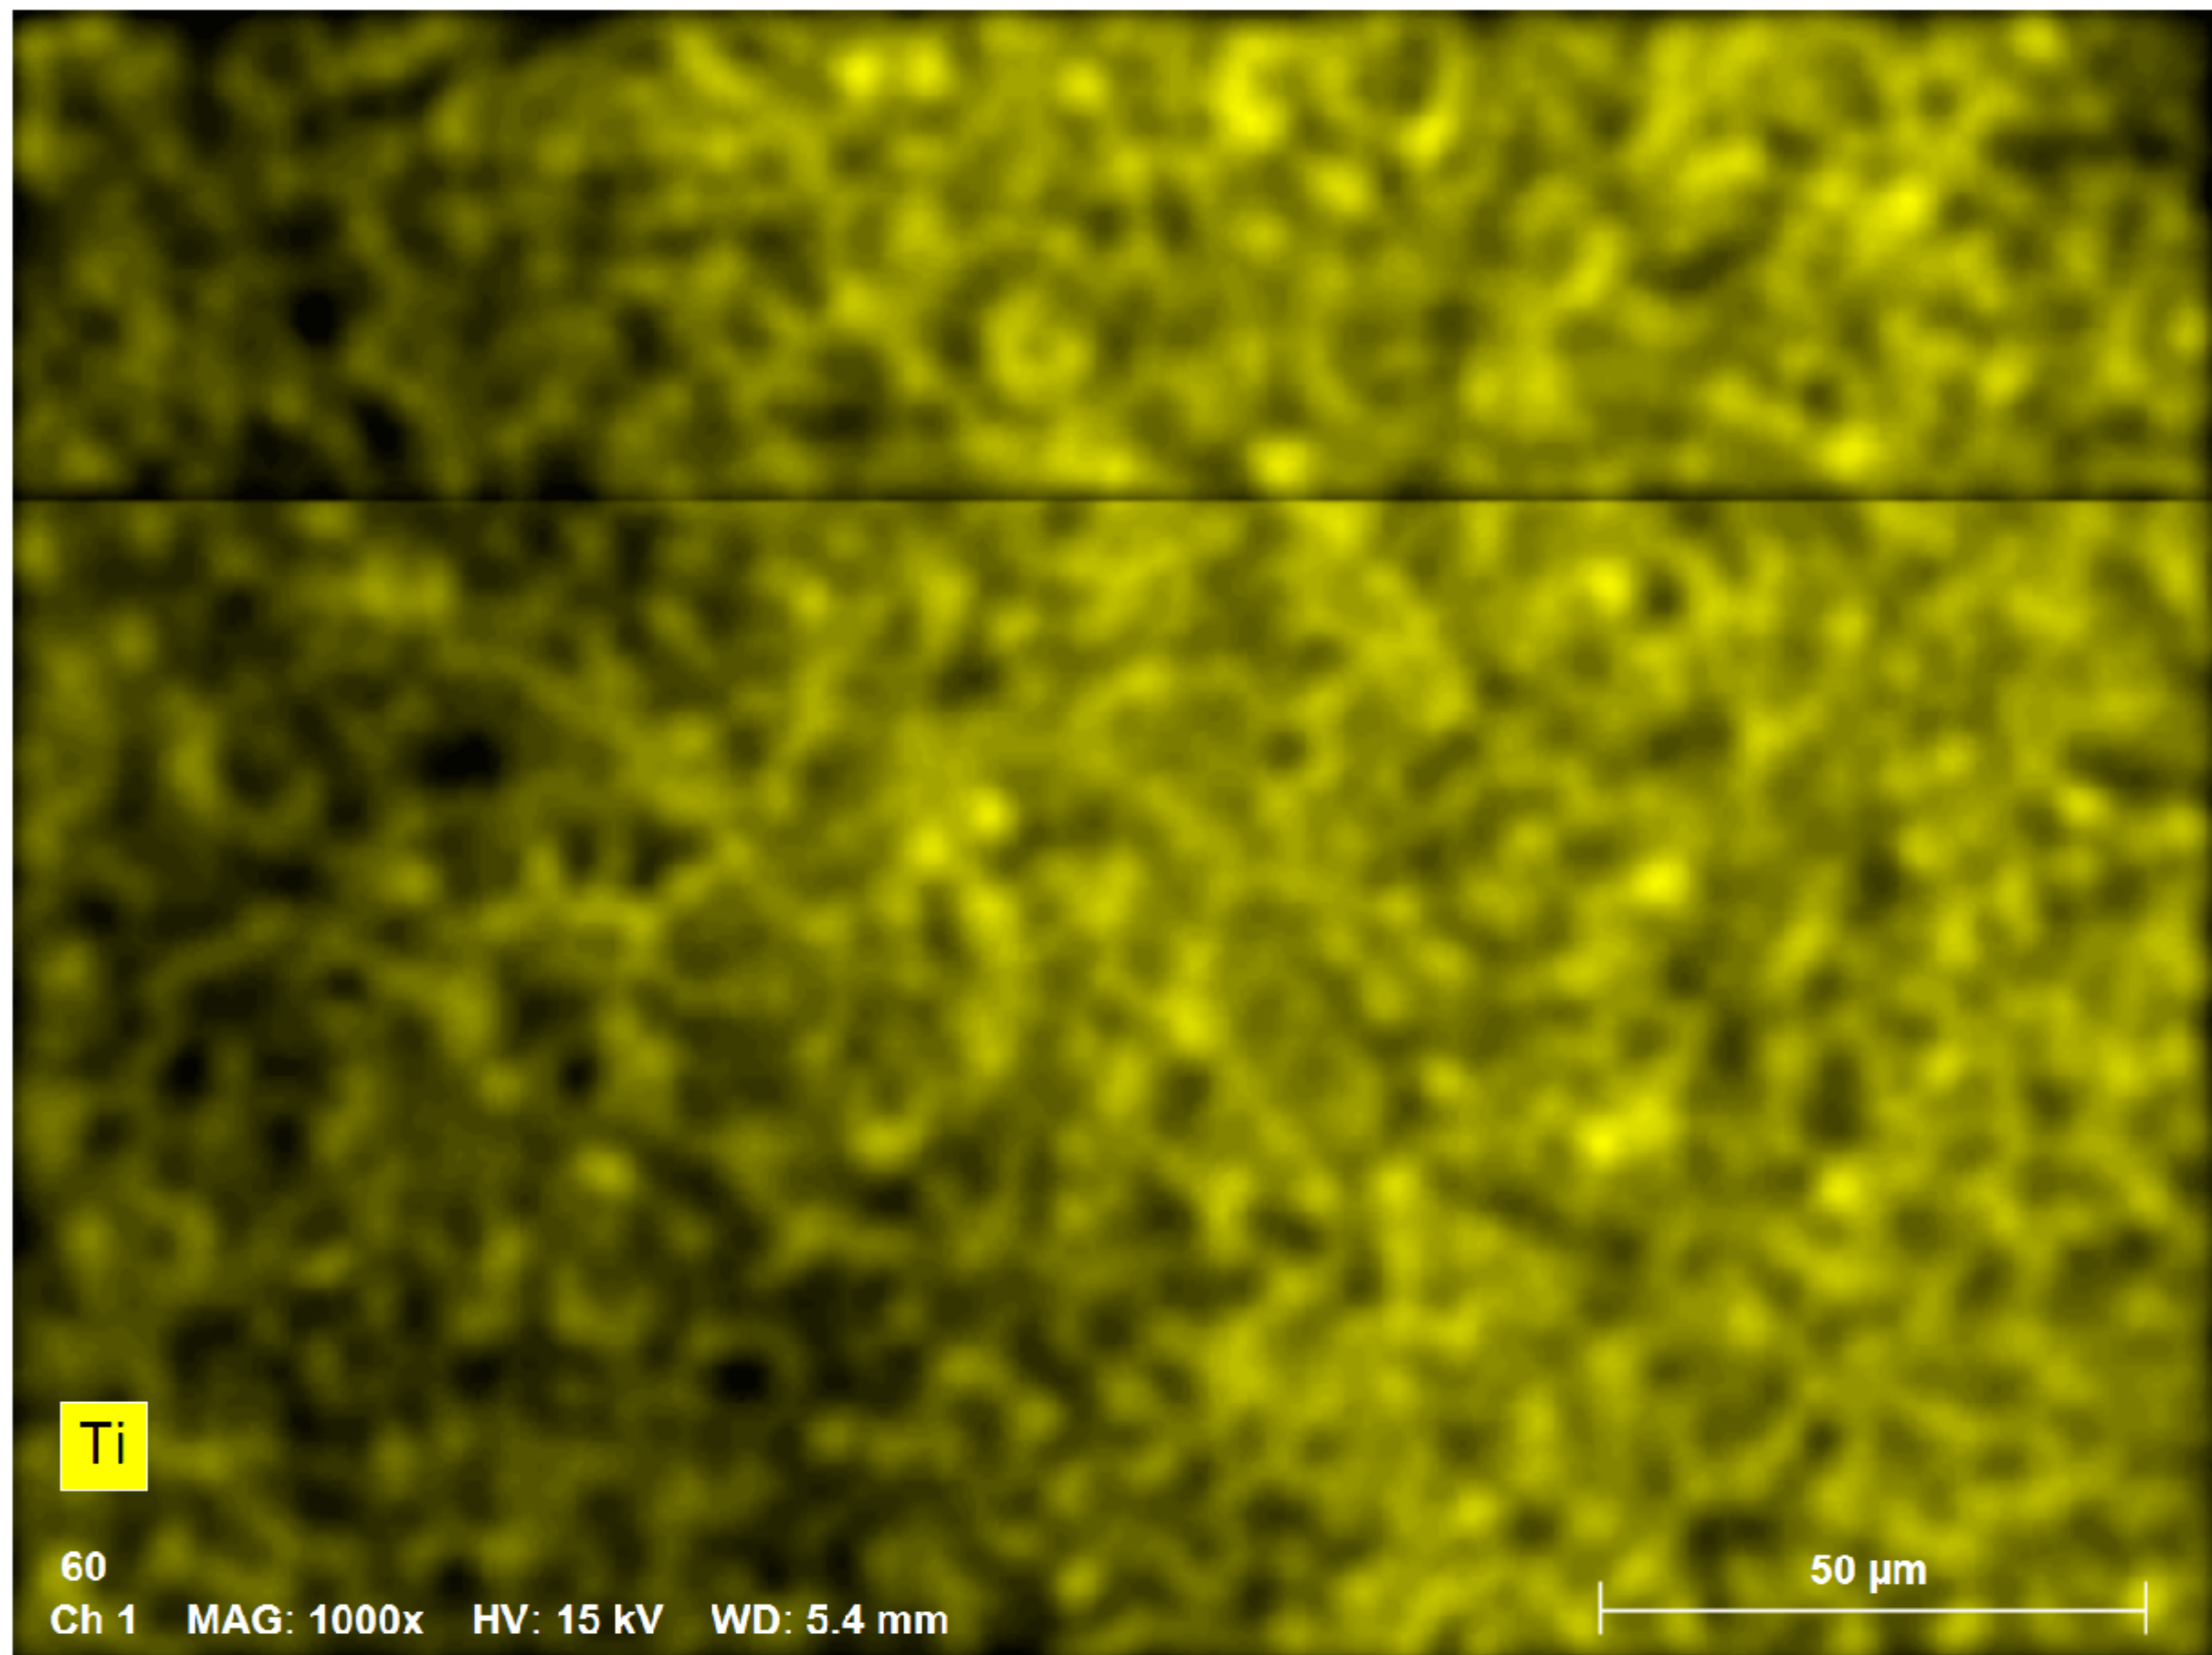



Application Note



Name	Date	Time	HV [kV]	Mag	WD [mm]
63	3/27/2025	12:51:39 PM	15.0 keV	1000x	5.4 mm

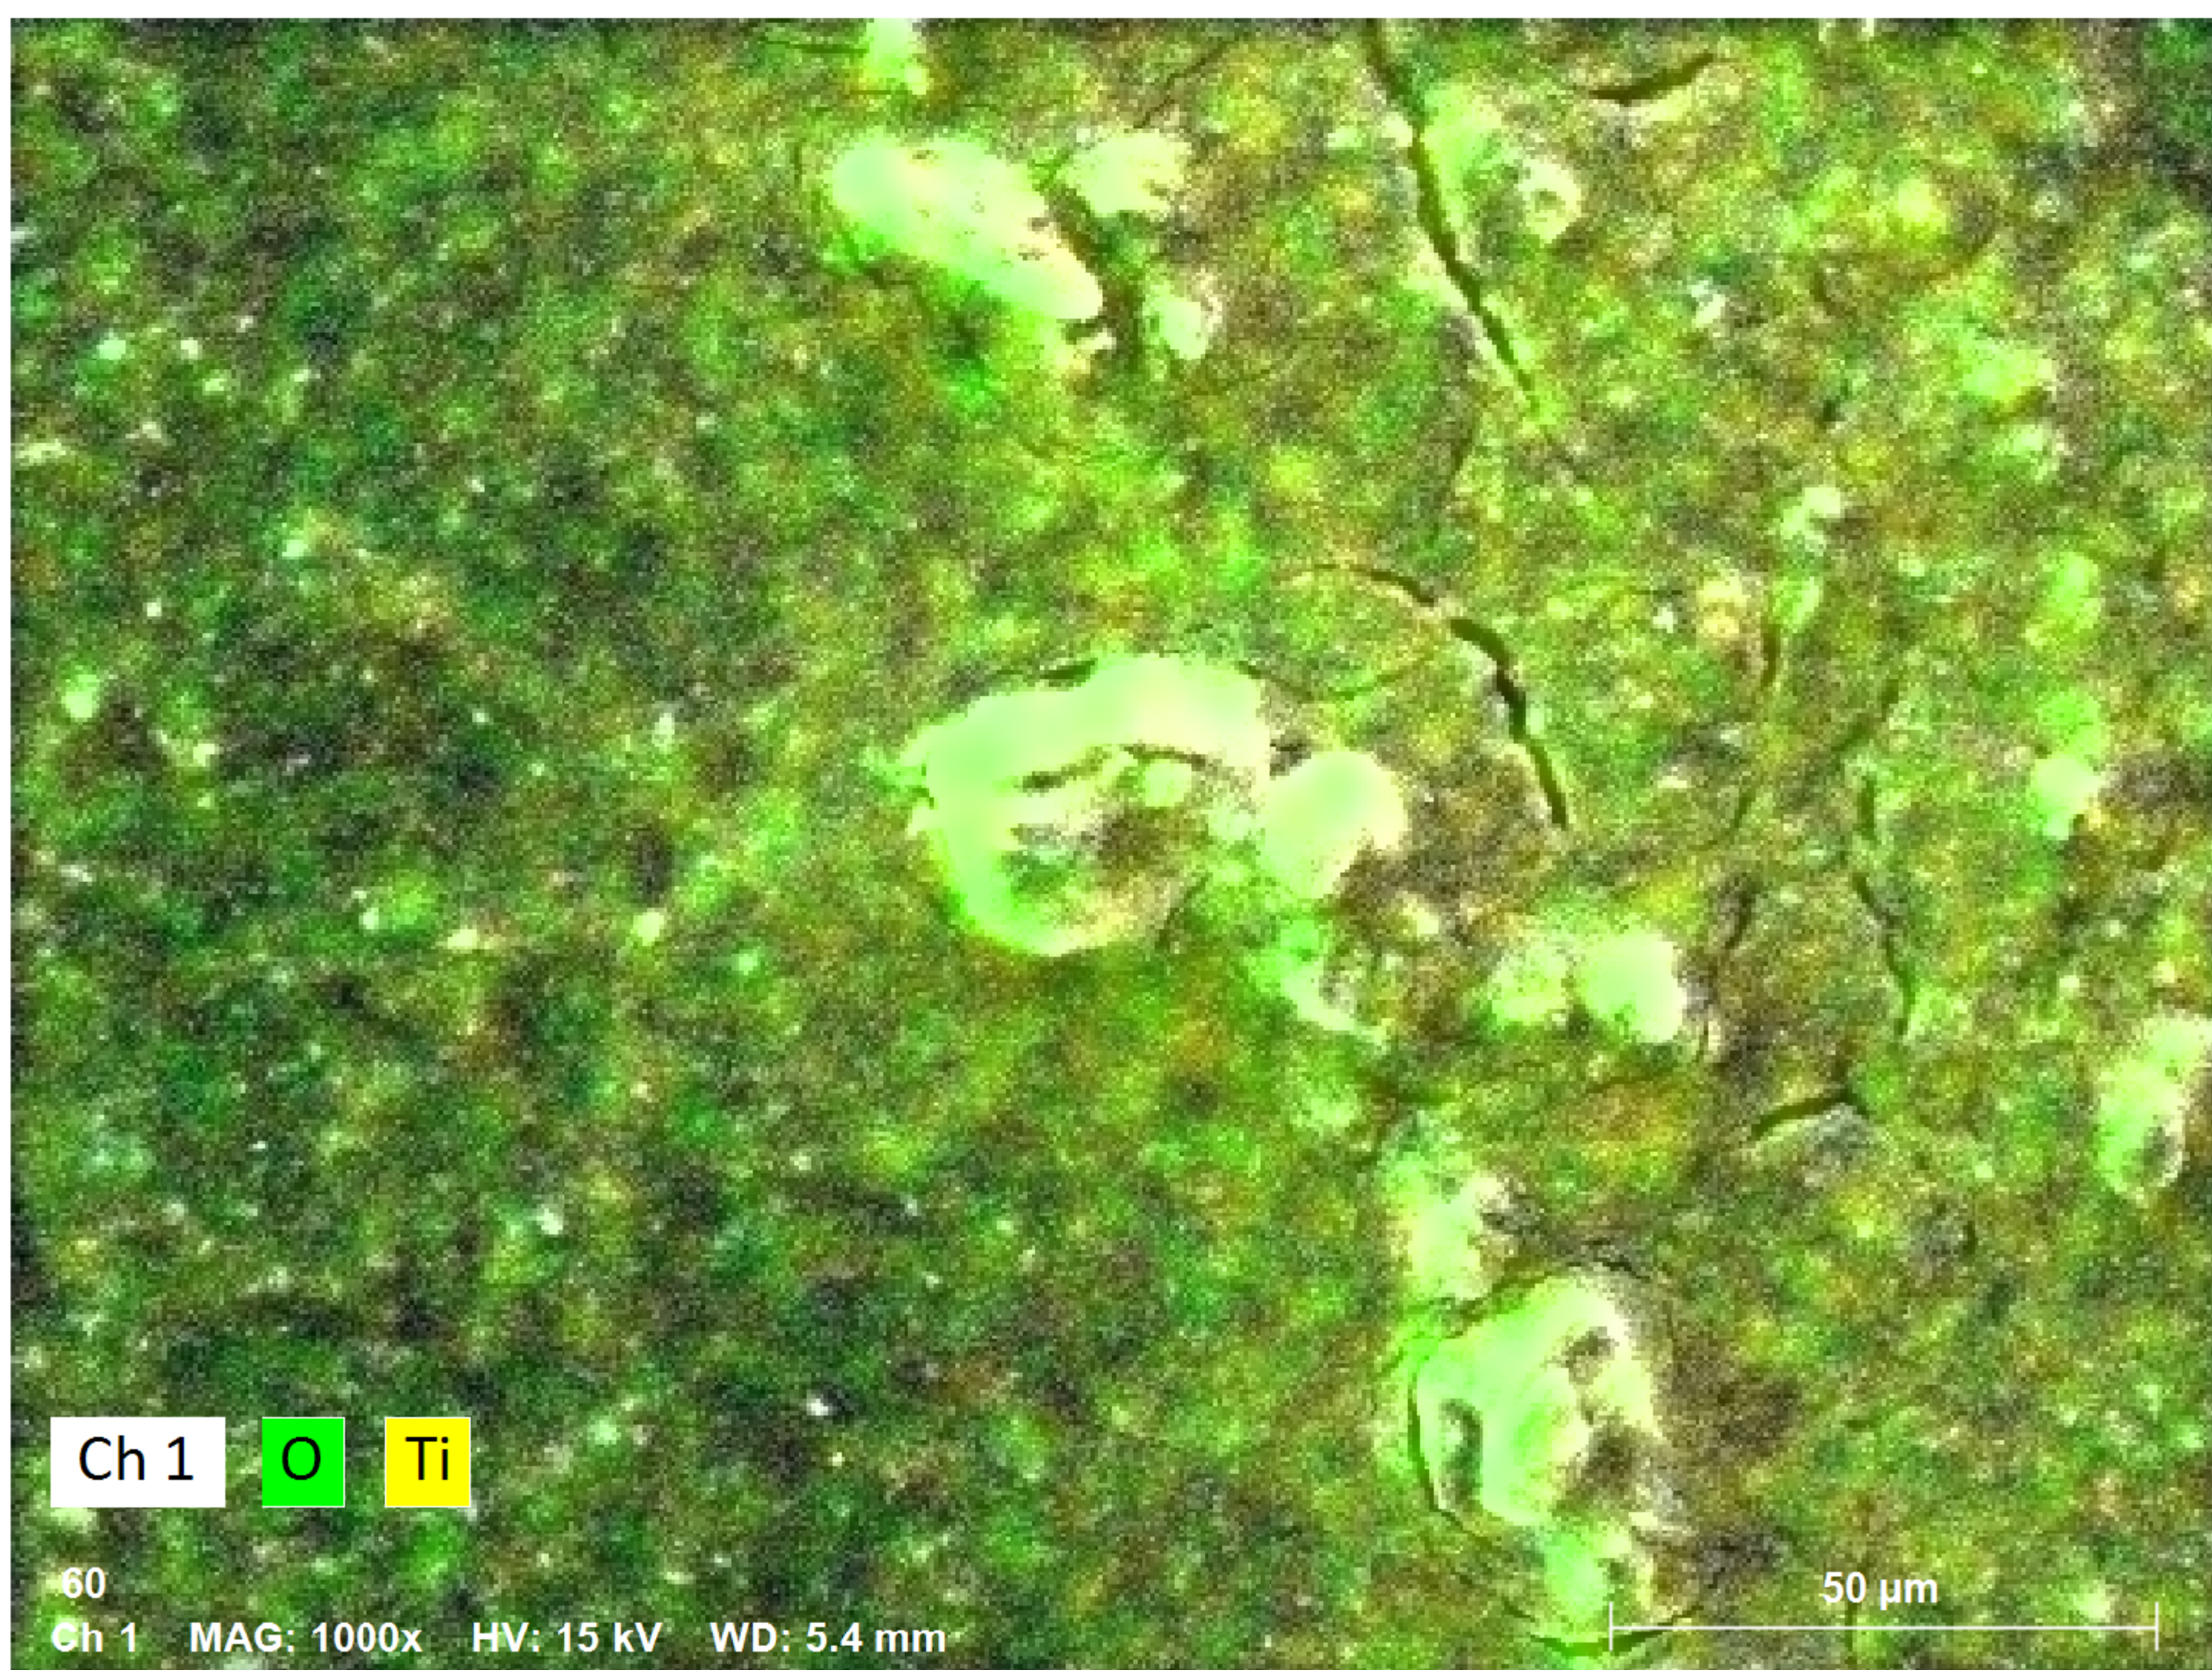


Name	Date	Time	HV [kV]	Mag	WD [mm]
60	3/27/2025	12:51:52 PM	15.0 keV	1000x	5.4 mm
3/27/2025					

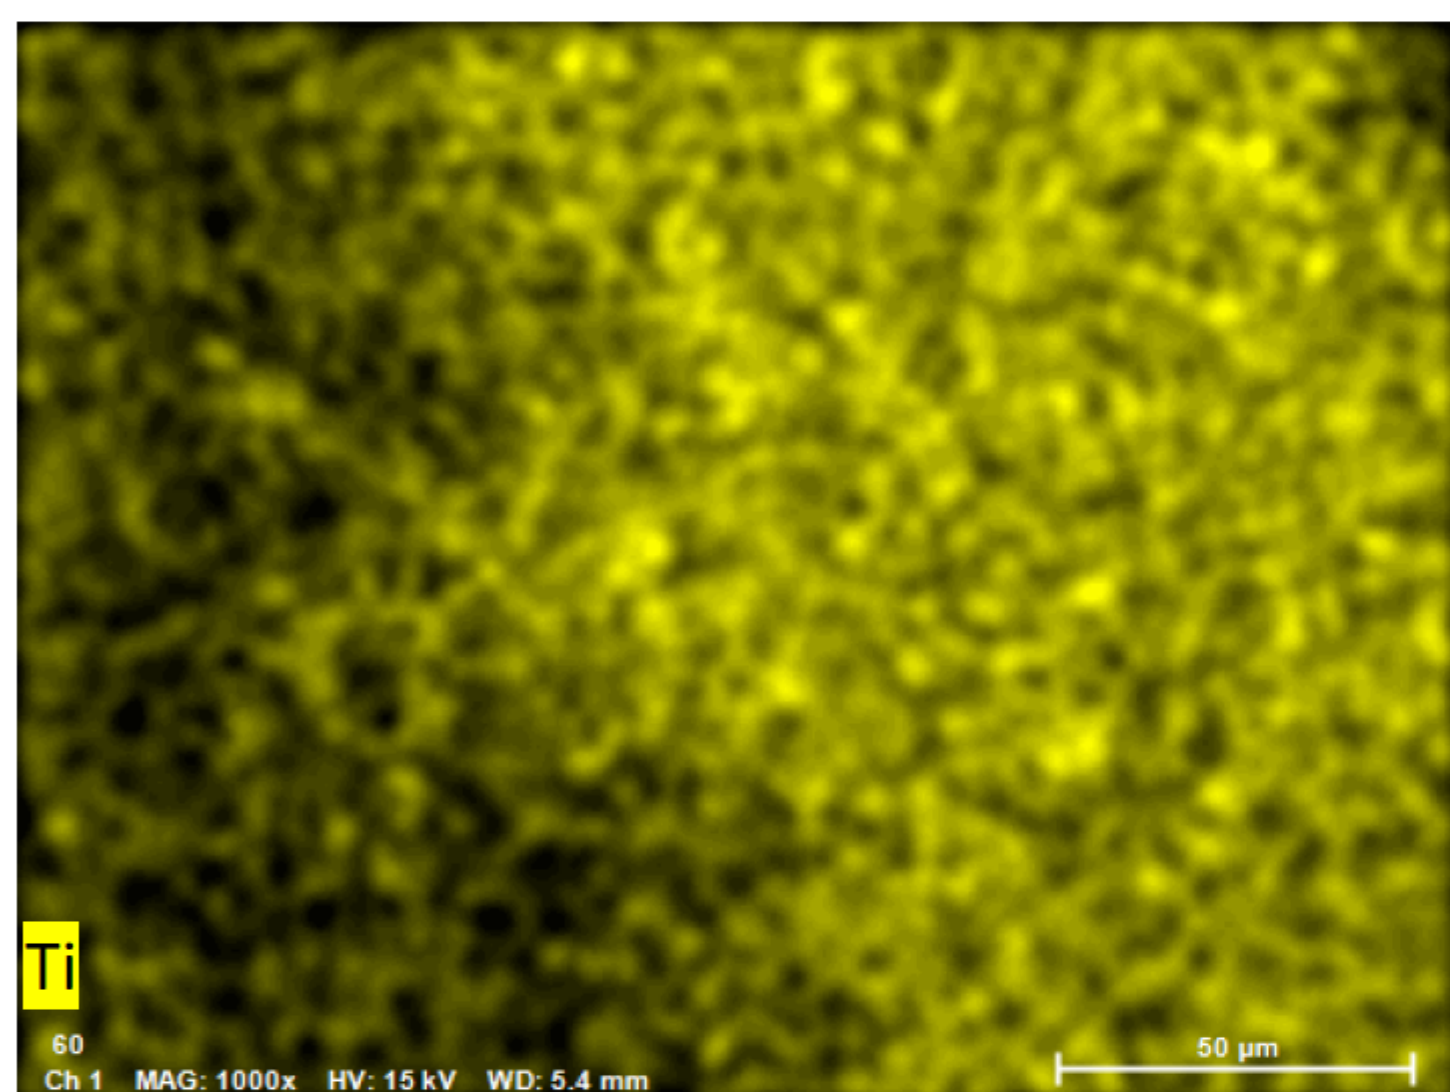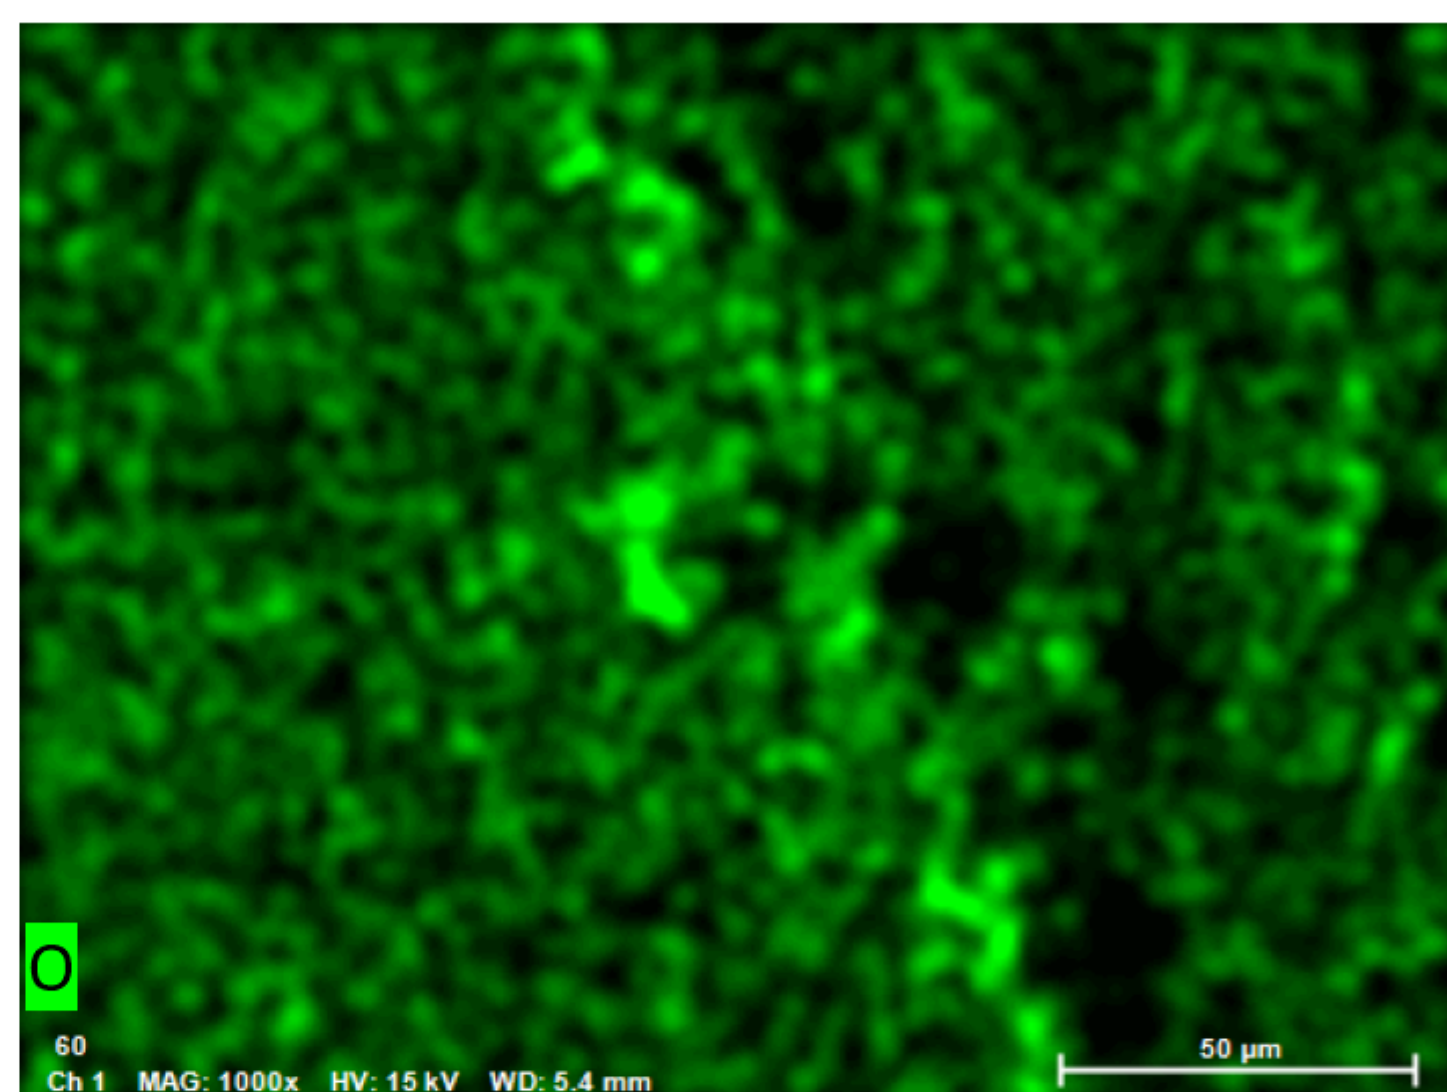


Date	Time	HV [kV]	Mag	WD [mm]
3/27/2025	12:51:52 PM	15.0 keV	1000x	5.4 mm


Application Note

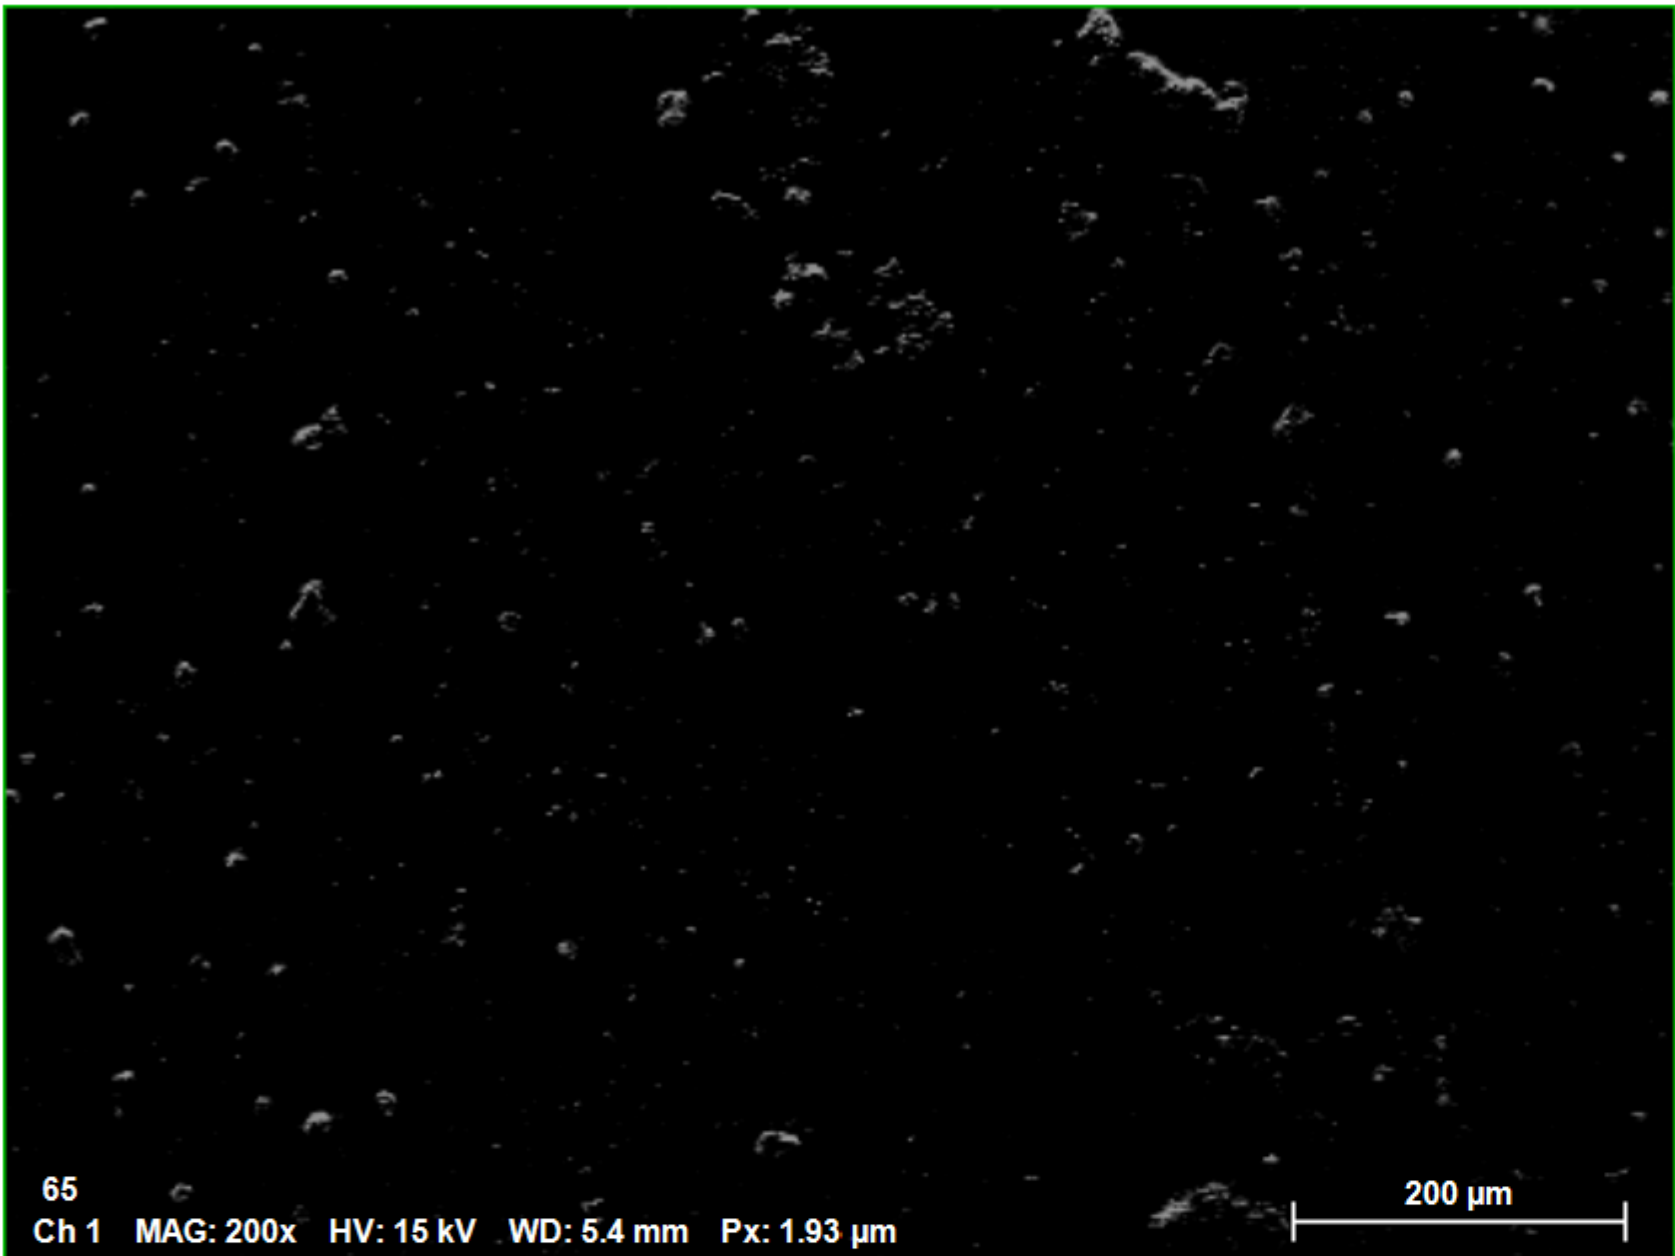

Name	Date	Time	HV [kV]	Mag	WD [mm]
65	3/27/2025	12:58:17 PM	15.0 keV	200x	5.4 mm

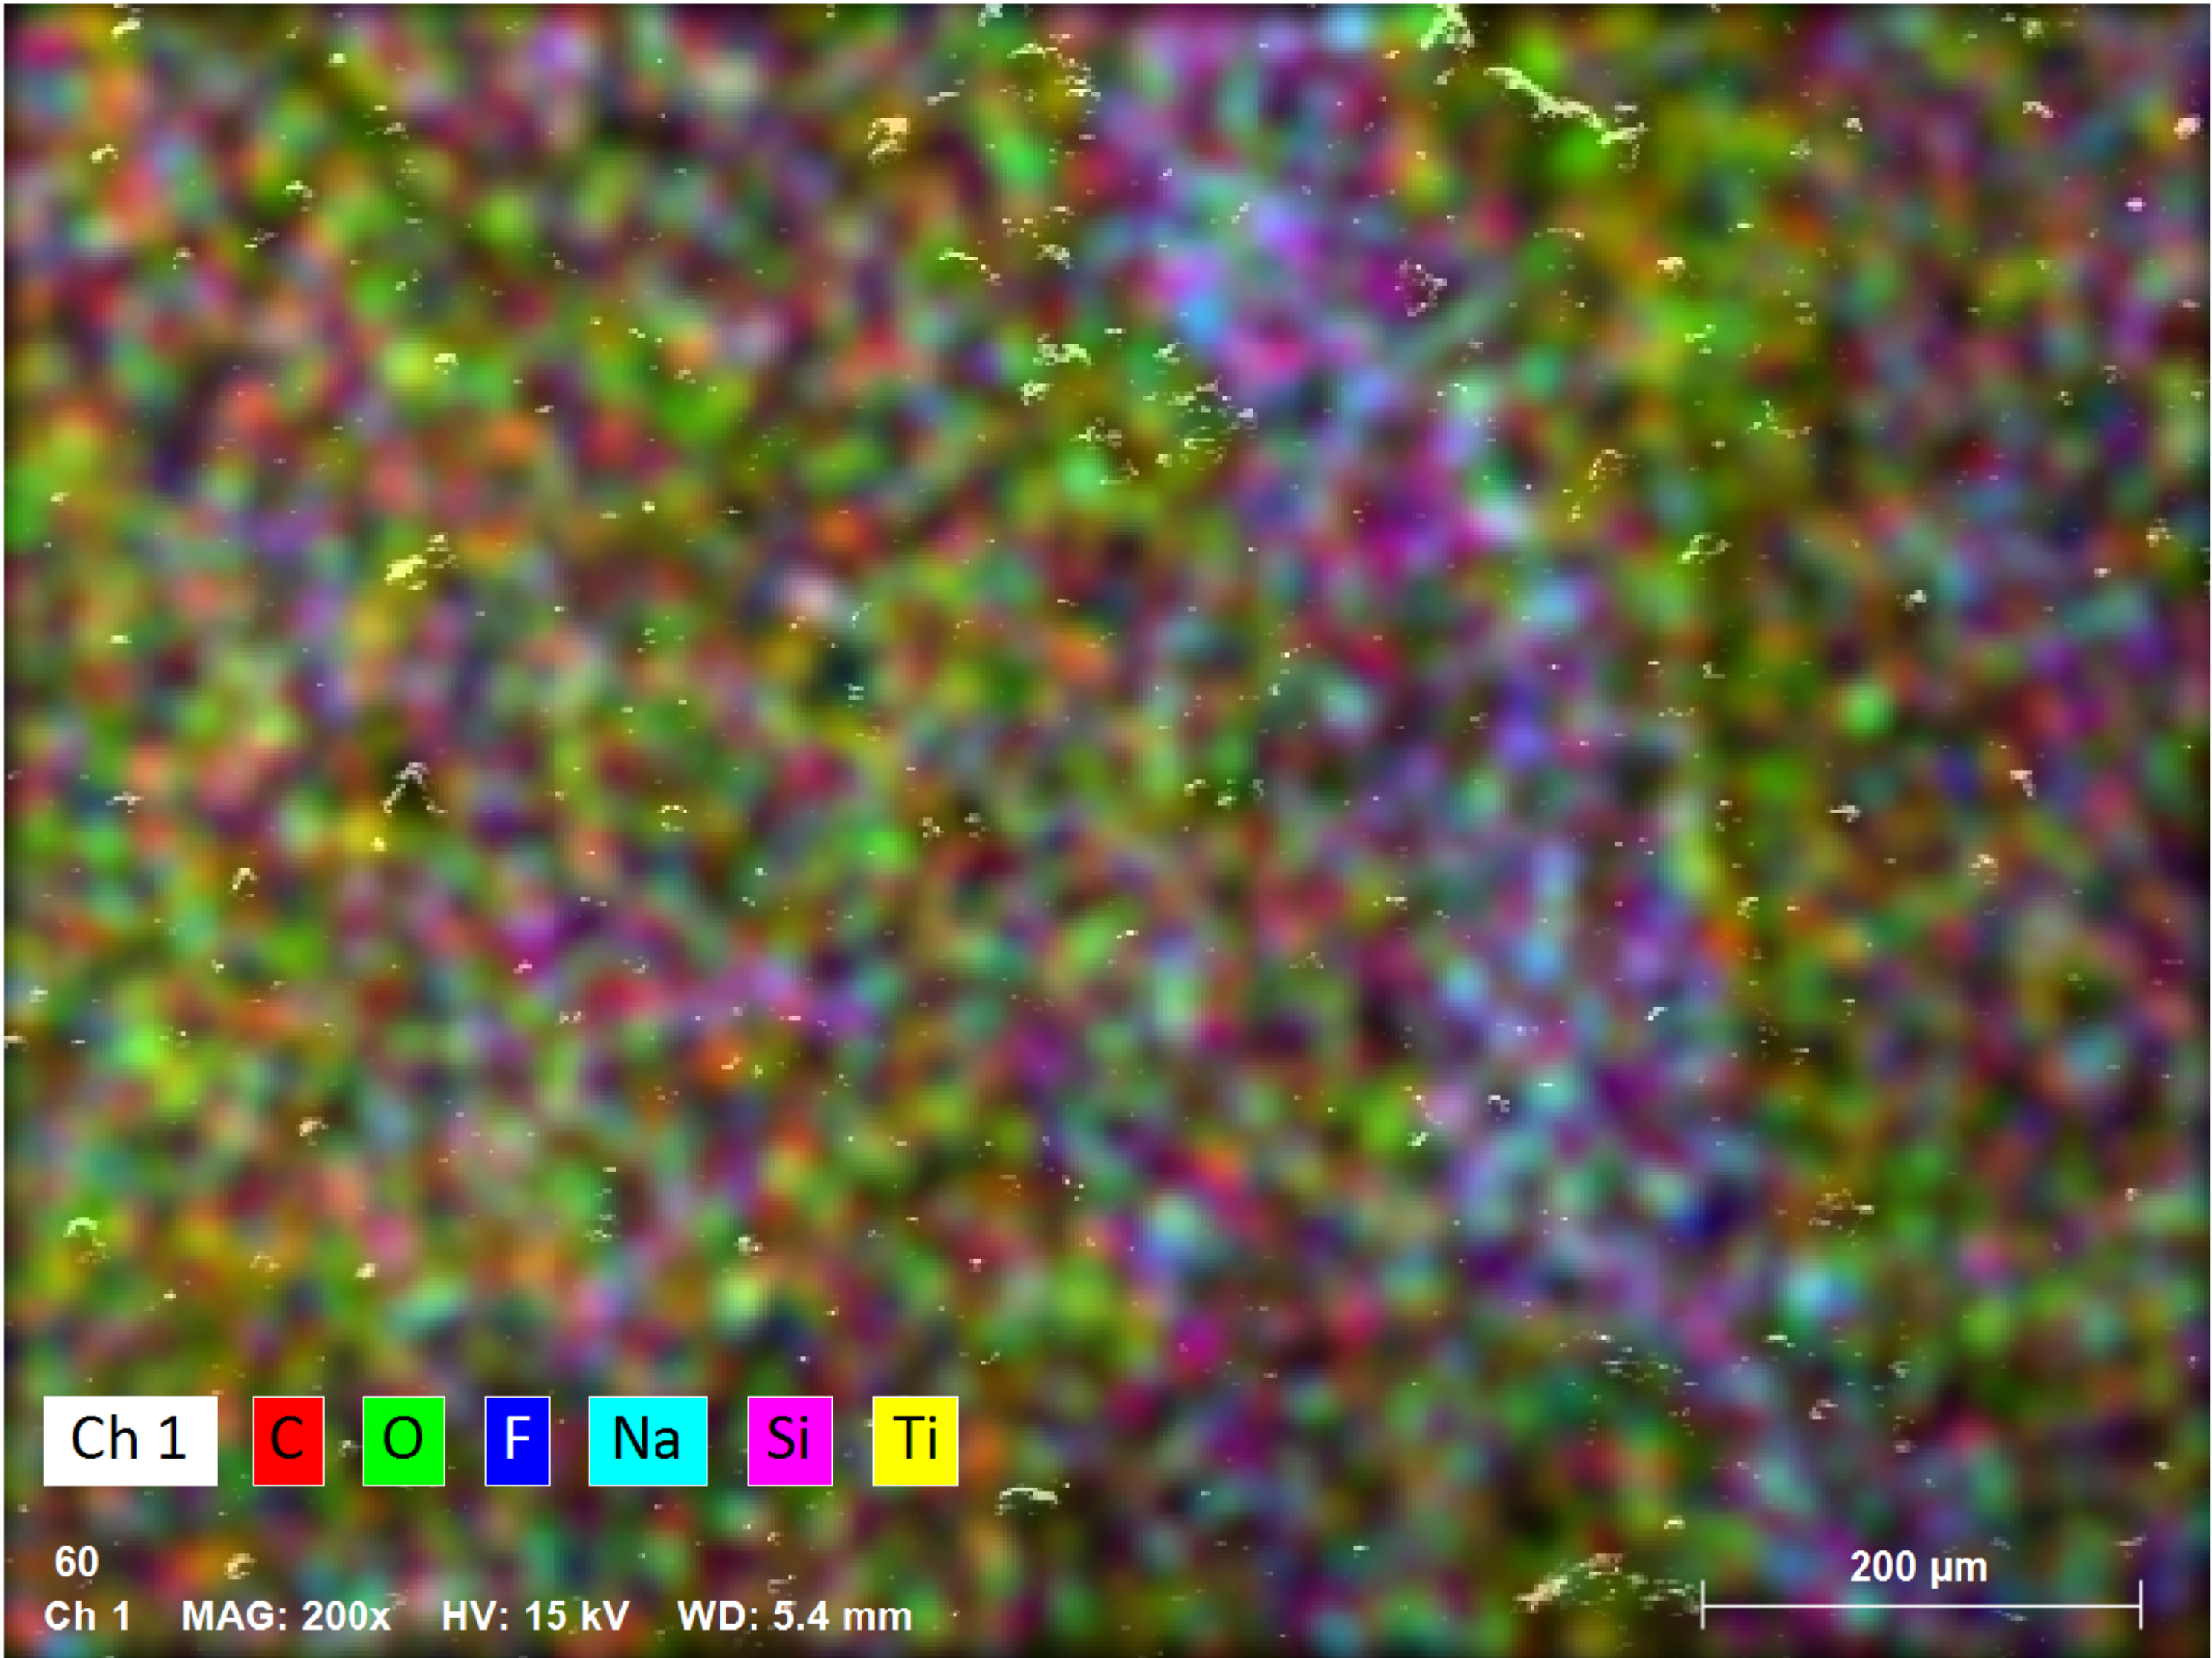

Name	Date	Time	HV [kV]	Mag	WD [mm]
60	3/27/2025	12:58:33 PM	15.0 keV	200x	5.4 mm
3/27/2025					

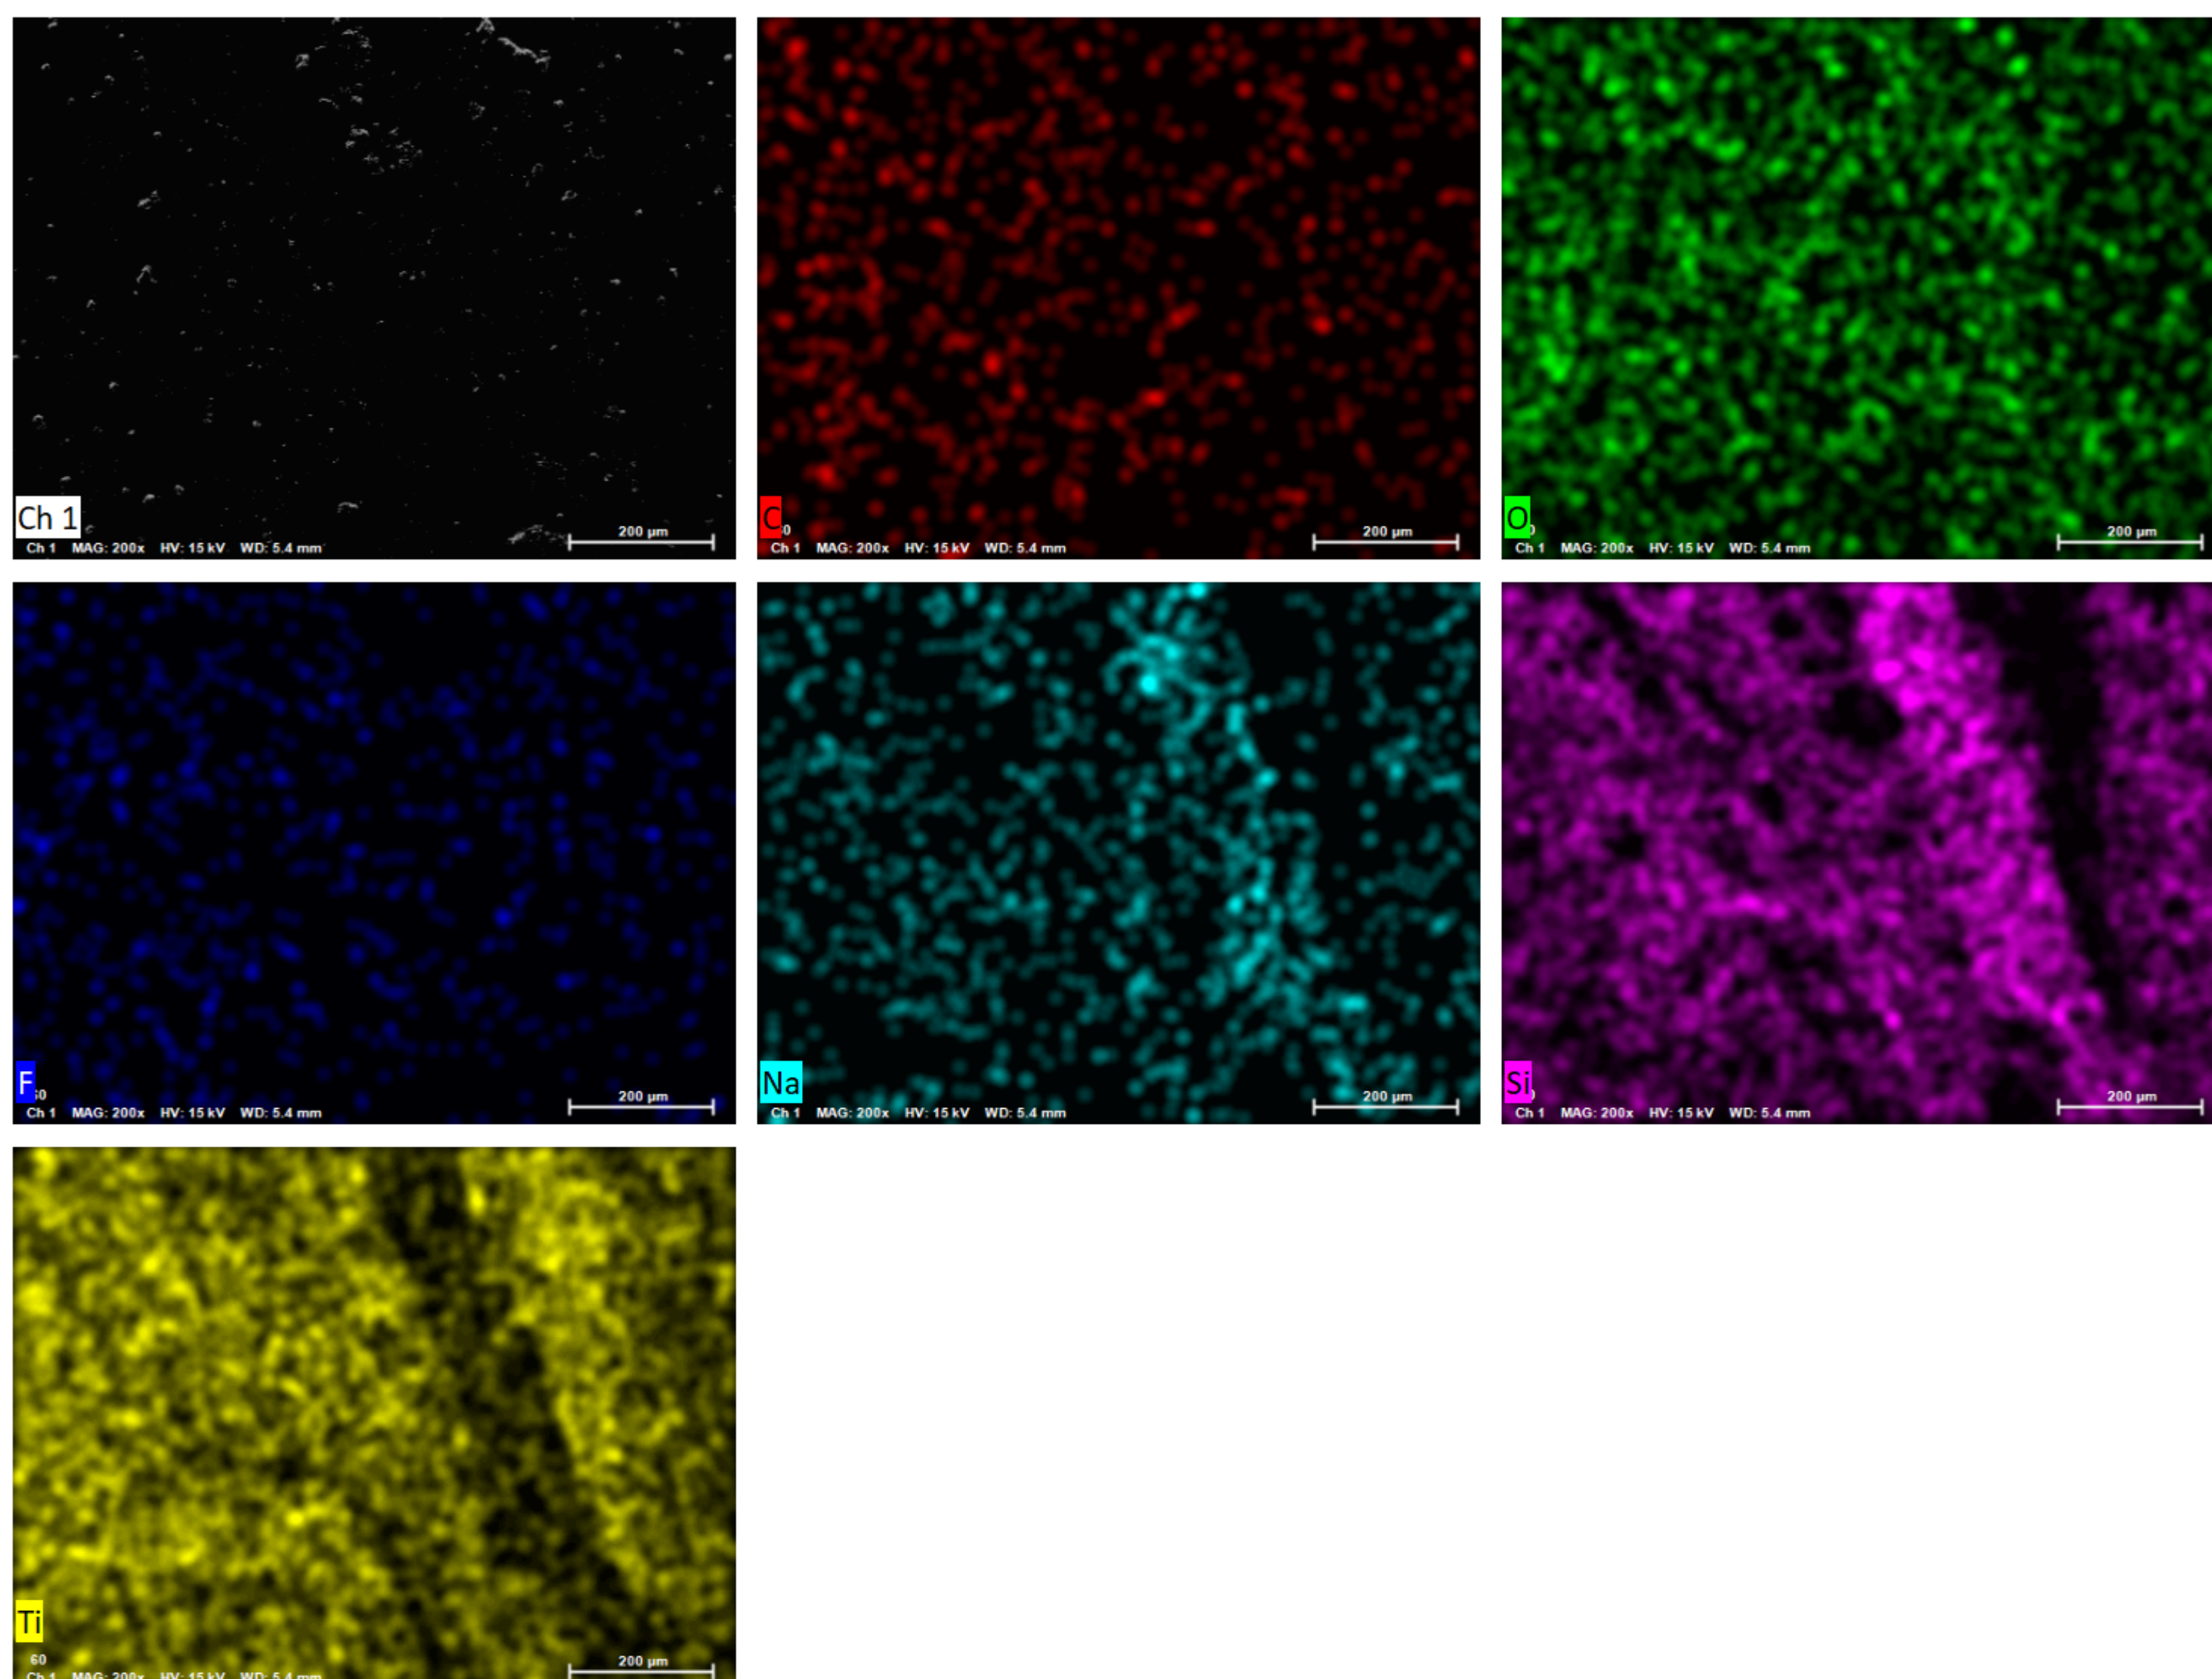

Date	Time	HV [kV]	Mag	WD [mm]
3/27/2025	12:58:33 PM	15.0 keV	200x	5.4 mm

Application Note

